


Protective releases

Microprocessor based overcurrent relays, PR212

Time-current curves, S4 – S8



Function L - S - I

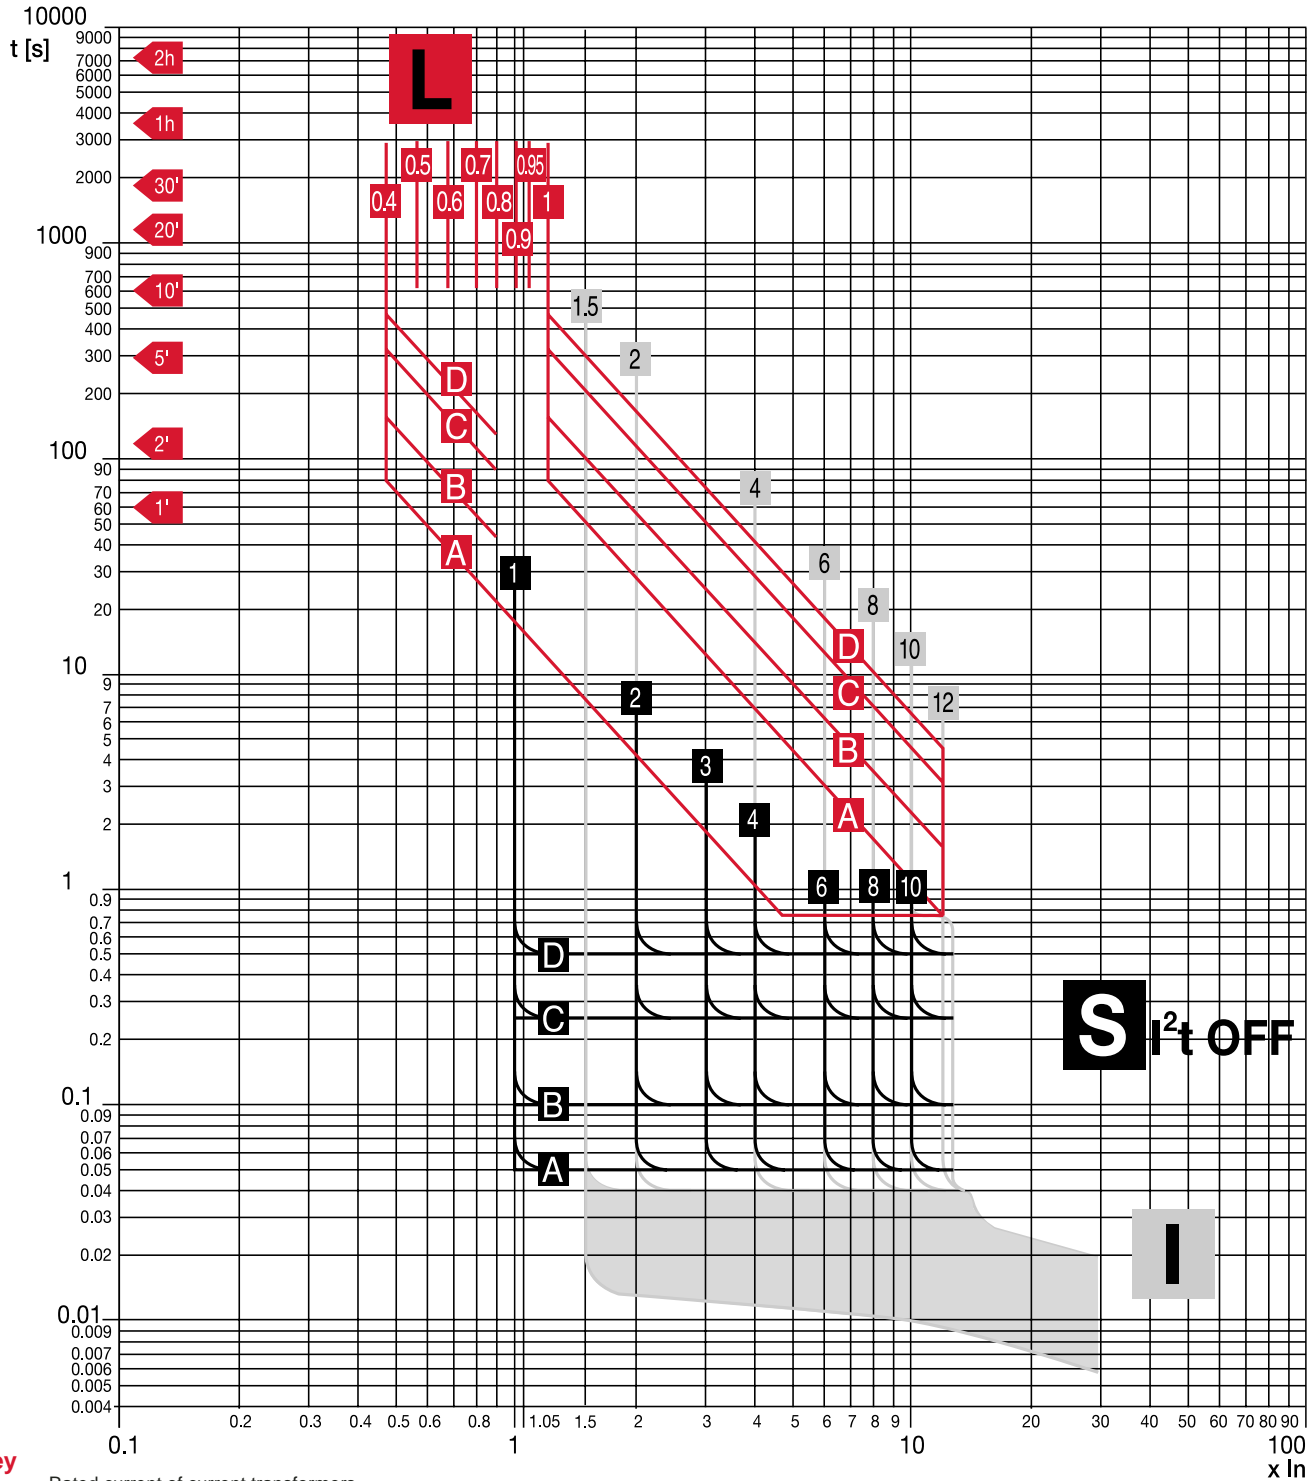

Key
 I_n = Rated current of current transformers
 t = Tripping time