




# Protective releases

## Microprocessor based overcurrent relays, PR212

### Time-current curves, S4 – S8

#### Function L - S - I

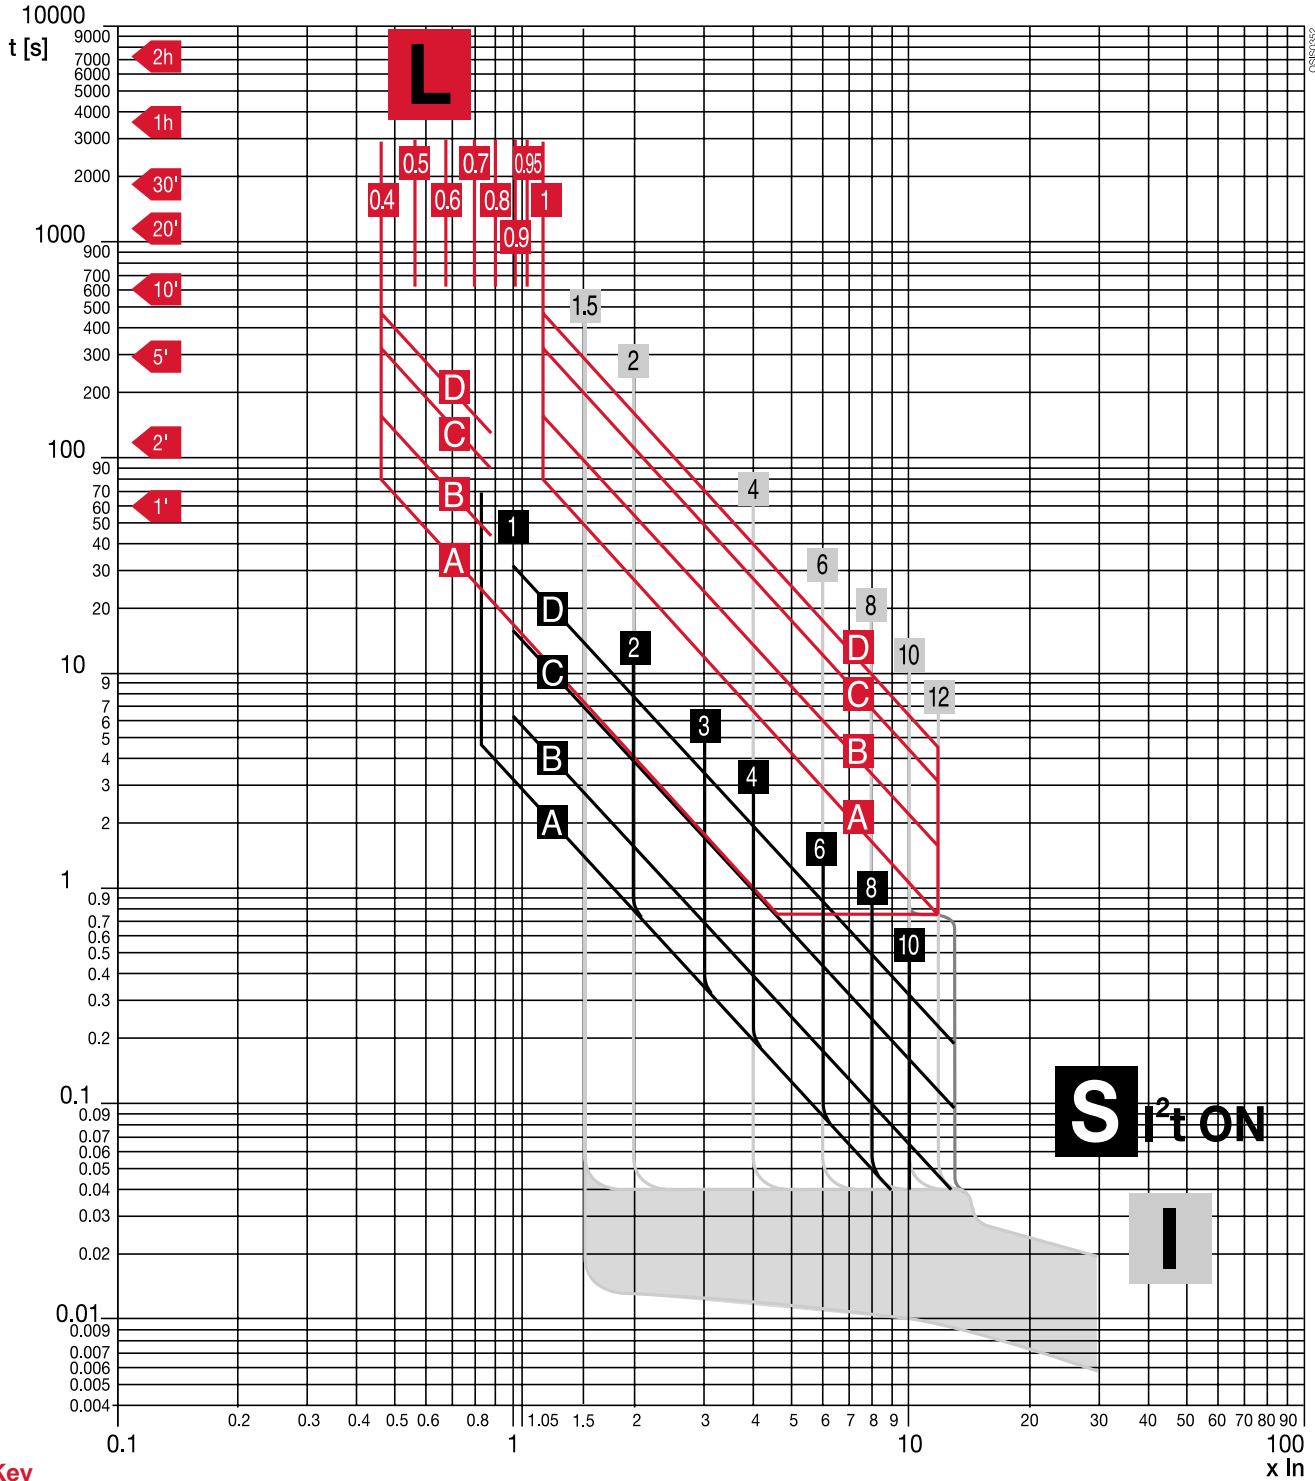

**Key**  
 $I_n$  = Rated current of current transformers  
 $t$  = Tripping time