


Protective releases

Microprocessor based overcurrent relays, PR212

Time-current curves, S4 – S8



Function G[®]

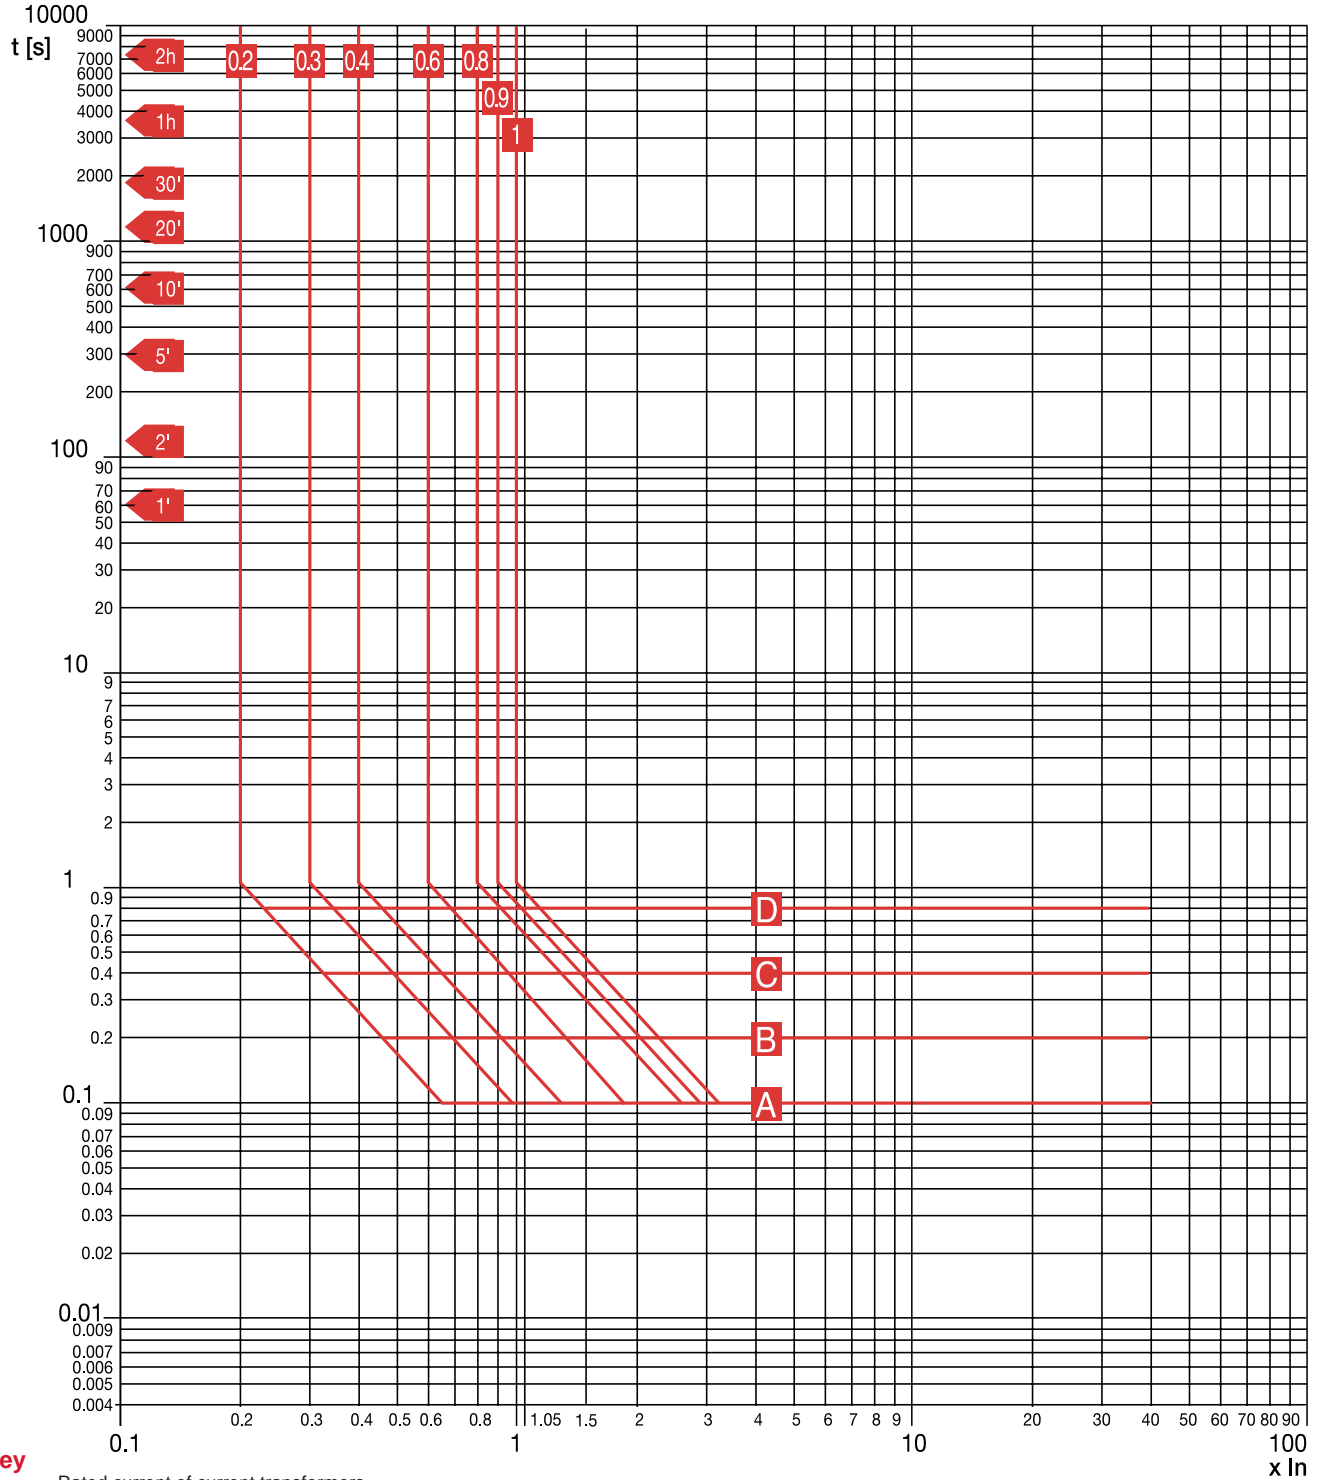

Key
 I_n = Rated current of current transformers
 t = Tripping time

© S8 maximum setting is 0.4 per NEC guidelines.