


# Circuit diagrams

## Position contacts

### S4 – S5

Isomax  
MCCBs

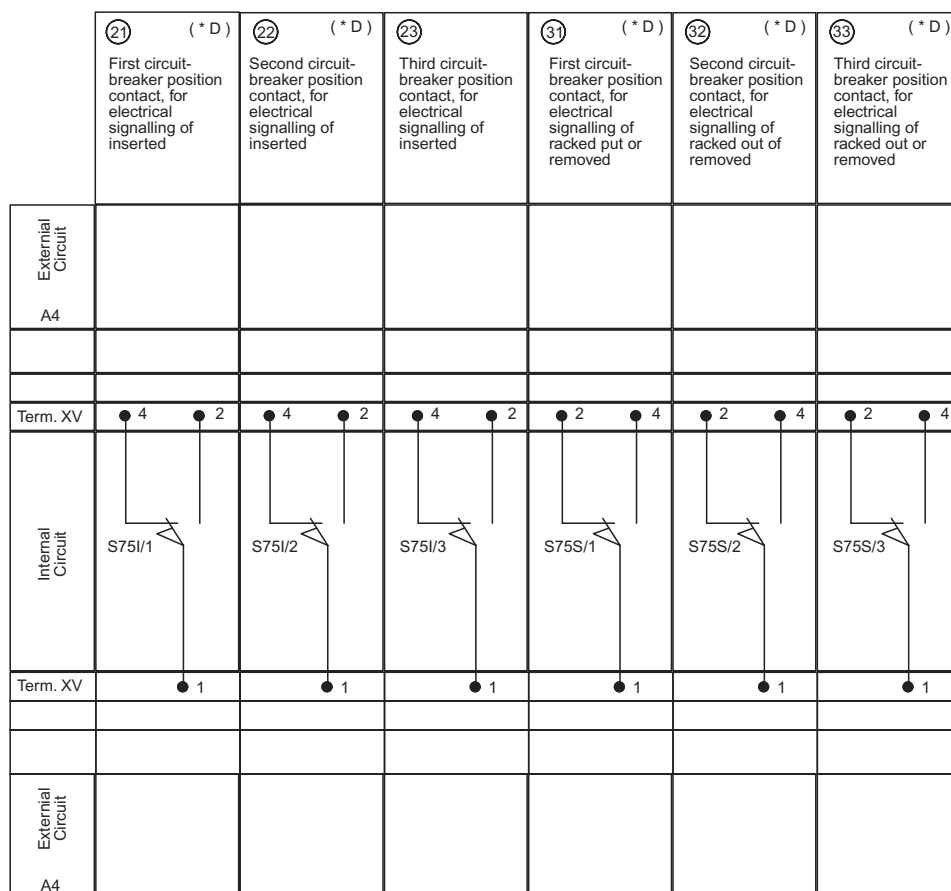

### Legend

- O- Figure number of diagram
- A4 - Example switchgear and connections for control and signalling, outside the circuit breaker
- S75I/1...5 - Contacts for electrical signalling of circuit breaker in inserted position (only for plug in or withdrawable circuit breakers, see Note D.)
- S75S/1...5 - Contacts for electrical signalling of circuit breaker in removed or racked out position (only for plug in or withdrawable circuit breakers, see Note D.)

### Incompatibility

The circuits indicated in the following figures cannot be powered simultaneously on the same circuit breaker:  
20 - 21 - 31, 22 - 32, 23 - 33, 24 - 34, 25 - 35

### Notes

(\*D) The circuit breaker can be mounted with position contacts S75I and S75S in any combination up to a maximum of:

- Total of 2 contacts for S3
- Total of 3 contacts for S4, S5
- Total of 5 contacts for S6, S7