


















IEC Technical data

A/AF145 — AF750














Connecting Characteristics

Contactor types:	A...	145	185	210	260	300	-	-	-	-
	AF...	145	185	210	260	300	400	460	580	750
Main terminals										
Flat type										
Connecting capacity (min. ... max.)										
Main conductors (poles)										
Rigid:	 1 x mm ²	-	-	-	-	-	-	-	-	-
	 2 x mm ²	-	-	-	-	-	-	-	-	-
Rigid with connector										
single for Cu cable	 mm ²	6 ... 185		16 ... 240		240		300		
single for Al/Cu cable	 mm ²	25 ... 150		120 ... 240		240		300		
double for Al/Cu cable	 mm ²	-		2 x 95 ... 120		2 x 240		3 x 185		
Flexible										
	 1 x mm ²	-	-	-	-	-	-	-	-	-
	 2 x mm ²	-	-	-	-	-	-	-	-	-
Bars or lugs	 L mm ≤	24		32		47 / 45		52 / 50		
	Ø mm >	8		10		10		12		
Auxiliary conductors (coil terminals)										
Rigid solid										
	 1 x mm ²	1 ... 4								
	 2 x mm ²	1 ... 4								
Flexible with cable end										
	 1 x mm ²	0.75 ... 2.5								
	 2 x mm ²	0.75 ... 2.5								
Lugs	 L mm ≤	8								
	l mm >	3.7								
Degree of protection acc. to IEC 60947-1 / EN 60947-1 and IEC 60529 / EN 60529		Protection against direct contact acc. to VDE 0106 - part 100								
- Main terminals		IP 00								
- Coil terminals		IP 20								
- Built-in auxiliary terminals		-								
Screw terminals		Screws and bolts								
Main terminals		M8	M10	M10	M12					
Coil terminals (delivered in open position)		M3.5 (+, -) pozidriv 2 screws with cable clamp								
Built-in auxiliary terminals		-	-	-	-	-	-	-	-	-
Tightening torque										
Main pole terminals										
- recommended	Nm / lb.in	18 / 160		28 / 240		40 / 354		45 / 443		
- max.	Nm	20		30		44		49		
Coil terminals										
- recommended	Nm / lb.in	1.00 / 9								
- max.	Nm	1.20								
Built-in auxiliary terminals										
- recommended	Nm / lb.in	-	-	-	-	-	-	-	-	-
- max.	Nm	-	-	-	-	-	-	-	-	-
Terminal marking and positioning		see pages 1.36 & 1.37								

IEC Technical data


AF1350 — AF1650

Connecting Characteristics

Contactor types: AF...		1350	1650
Main terminals Flat type			
Connecting capacity (min. ... max.) Main conductors (poles)			
Rigid:	 1 x mm ²	—	—
	 2 x mm ²	—	—
Rigid with connector			
single for Cu cable	 mm ²	—	—
single for Al/Cu cable	 mm ²	—	—
double for Al/Cu cable	 mm ²	—	—
Flexible	 1 x mm ²	—	—
	 2 x mm ²	—	—
Bars or lugs	 L mm ≤ Ø mm >	100 12	100 12
Auxiliary conductors (coil terminals)			
Rigid solid	 1 x mm ²	1...4	1...4
	 2 x mm ²	1...4	1...4
Flexible with cable end	 1 x mm ²	0.75...2.5	0.75...2.5
	 2 x mm ²	0.75...2.5	0.75...2.5
Lugs	 L mm ≤ l mm >	8 3.7	8 3.7
Degree of protection acc. to IEC 60947-1 / EN 60947-1 and IEC 60529 / EN 60529			
– Main terminals		IP 00	IP 00
– Coil terminals		IP 20	IP 20
– Built-in auxiliary terminals			
Screw terminals Main terminals		Screw and bolts M12	
Coil terminals (delivered in open position)		M3.5 (+,-) pozidriv 2 screws with cable clamp	
Built-in auxiliary terminals		—	—
Tightening torque			
Main pole terminals			
– recommended	Nm / lb.in	45/443	45/443
– max.	Nm	49	49
Coil terminals			
– recommended	Nm / lb.in	1.00 / 9	1.00 / 9
– max.	Nm	1.20	1.20
Built-in auxiliary terminals			
– recommended	Nm / lb.in	—	—
– max.	Nm	—	—

UL/CSA & IEC Technical data

AL9 — AL40

Contactor types:	AL	AL9	AL12	AL16	AL26	AL30	AL40
Rated insulation voltage U_i according to IEC 60947-4-1	V				1000		
according to UL/CSA	V				600		
Rated impulse withstand voltage U_{imp}	kV				8		
Standards		Devices complying with international standards IEC 60947-1 / 60947-4-1 and European standards EN 60947-1 / 60947-4-1					
Air temperature close to contactor		see "Conditions for use" page 1.50, for control voltage limits and authorized mounting positions					
- fitted with thermal O/L relay	°C	-25 to +55					
- without thermal O/L relay	°C	-40 to +70 (55 max. for TAE... contactors)					
- for storage	°C	-60 to +80					
Climatic withstand		acc. to IEC 60068-2-30 and 60068-2-11 - UTE C 63-100 specification II					
Operating altitude	m	≤ 3000					
Shock withstand acc. IEC 60068-2-27 and EN 60068-2-27		1/2 sinusoidal shock for 11 ms: no change in contact position					
Mounting position 1 (see page 1.50)		Shock direction	Making position	Breaking position			
		A	20 g	20 g			
		B1	10 g	5 g			
		B2	15 g	15 g			
		C1	20 g	20 g			
		C2	20 g	20 g			

IEC Technical data

AL9 — AL40

Across the line
contactors

1

Main Pole - Utilization Characteristics

Contactor types:	AL	AL9	AL12	AL16	AL26	AL30	AL40	
Rated operational voltage U_e max.	V	690						
Rated frequency limits	Hz	25-400						
Conventional free-air thermal current I_{th} acc. to IEC 60947-4-1,								
open contactors $\varnothing \leq 40$ °C	A	26	28	30	45	65	65	
with conductor cross-sectional area mm^2	4	4	4	6	16	16	35	
Rated operational current I_e / AC-1 for air temperature close to contactor								
U_e max. 690 V	$\varnothing \leq 40$ °C	A	25	27	30	45	55	60
	$\varnothing \leq 55$ °C	A	22	25	27	40	55	60
	$\varnothing \leq 70$ °C ^③	A	18	20	23	32	39	42
with conductor cross-sectional area mm^2		2.5	4	4	6	10	16	
Utilization categorie AC-3 for air temperature close to contactor ≤ 55 °C								
Rated operational current I_e AC-3 ^①								
3-phase motors	220-230-240 V	A	9	12	17	26	33	40
	380-400 V	A	9	12	17	26	32	37
	415 V	A	9	12	17	26	32	37
	440 V	A	9	12	16	26	32	37
	500 V	A	9	12	14	22	28	33
	690 V	A	7	9	10	17	21	25
	1000 V	A	—	—	—	—	—	—
Rated operational power AC-3 ^①								
1500 r.p.m. 50 Hz 1800 r.p.m. 60 Hz 3-phase motors	220-230-240 V	kW	2.2	3	4	6.5	9	11
	380-400 V	kW	4	5.5	7.5	11	15	18.5
	415 V	kW	4	5.5	9	11	15	18.5
	440 V	kW	4	5.5	9	15	18.5	22
	500 V	kW	5.5	7.5	9	15	18.5	22
	690 V	kW	5.5	7.5	9	15	18.5	22
	1000 V	kW	—	—	—	—	—	—
Rated making capacity AC-3 according to IEC 60947-4-1								
				10 x I_e AC-3				
Rated breaking capacity AC-3 according to IEC 60947-4-1								
				8 x I_e AC-3				
Short-circuit protection for contactors without thermal O/L relay - Motor protection excluded								
$U_e \leq 500$ V a.c. - gG type fuse	A	25	32	32	50	63		
Rated short-time withstand current I_{cw} at 40 °C ambient temp., in free air, from a cold state								
1 s	A	250	280	300	400	600		
10 s	A	100	120	140	210	400		
30 s	A	60	70	80	110	225		
1 min	A	50	55	60	90	150		
15 min	A	26	28	30	45	65		
Maximum breaking capacity $\cos \varnothing = 0.45$ ($\cos \varnothing = 0.35$ for $I_e > 100$ A)								
at 440 V	A	250	—	—	420	820		
at 690 V	A	90	—	—	170	340		
Heat dissipation per pole								
I_e / AC-1	W	0.8	1	1.2	1.8	2.5		
I_e / AC-3	W	0.1	0.2	0.35	0.6	0.9		
Max. electrical switching frequency								
- for AC-1	cycles/h	600						
- for AC-3	cycles/h	1200						
- for AC-2, AC-4	cycles/h	300						
Mechanical durability								
- millions of operating cycles		10						
- max. mechanical switching frequency	cycles/h	3600						



IEC Technical data

AL9 — AL40, TAL9 – TAL40

Magnet system characteristics for AL contactors

Contactor types:	AL	AL9	AL12	16	26	30	40
Rated control circuit voltage U_c	V d.c.	12 ... 240 (24V & 48V for AL...Z)					
Coil operating limits according to IEC 60947-4-1		$\theta \leq 55^\circ\text{C}$ 0.85 ... 1.1 x U_c					
Drop-out voltage in % of U_c		roughly 15 ... 30 %					
Coil consumption - Average values							
- pull-in value	W	3 (2.4 for AL9Z - AL16Z)			3.5		
- holding value	W	3 (2.4 for AL9Z - AL16Z)			3.5		
Coil time constant							
- open	L/R	ms	40				
- closed	L/R	ms	90				
Operating time between coil energization and:							
- N.O. contact closing		ms	50 ... 75				
- N.C. contact opening		ms	45 ... 70				
Operating time between coil de-energization and:							
- N.O. contact opening		ms	15 ... 30				
- N.C. contact closing		ms	17 ... 32				

Magnet System Characteristics for TAL... Contactors

Contactor types:	TAL	TAL9	TAL12	TAL16	TAL26	TAL30	TAL40
Rated control circuit voltage U_c	V d.c.	9 ... 264					
Coil operating limits according to IEC 60947-4-1		$\theta \leq 55^\circ\text{C}$ 0.85 ... 1.1 x U_c					
Drop-out voltage in % of U_c max.		roughly 20... 35 %					
Coil consumption values for U_c max. and 20 °C							
- U_c max. DC	W	8.5			9		
- U_c min. DC	W	2.5			2.7		
- U_c DC	W	5			5.4		
Operating time between coil energization and:							
- N.O. contact closing		ms	50 ... 100		55 ... 110		
- N.C. contact opening		ms	20 ... 70		25 ... 75		
Operating time between coil de-energization and:							
- N.O. contact opening		ms	10 ... 17 ①		12 ... 18 ①		
- N.C. contact closing		ms	16 ... 27 ①		18 ... 28 ①		

① The use of surge suppressors increases the opening time on a scale of 1.1 to 1.5 for a varistor suppressor and on a scale of 4 to 8 for a diode suppressor.

IEC Technical data

AL9 — AL40

Across the line
contactors

1

Built-in Auxiliary Contacts - Utilization Characteristics

Contactor types: AL	AL9	AL12	AL16	AL26	AL30	AL40
Rated operational voltage U_e max. V	690					
Conventional free air thermal current I_{th} - $\vartheta \leq 40$ °C A	16					
Rated frequency limits Hz	25 ... 400					
Rated operational current I_e / AC-15 according to IEC 60947-5-1						
24-127 V 50/60 Hz A	6					
220-240 V 50/60 Hz A	4					
380-440 V 50/60 Hz A	3					
500 V 50/60 Hz A	2					
690 V 50/60 Hz A	2					
Rated operational current I_e / DC-13 according to IEC 60947-5-1						
24 V d.c. A / W	6 / 144					
48 V d.c. A / W	2.8 / 134					
72 V d.c. A / W	2 / 144					
125 V d.c. A / W	1.1 / 138					
250 V d.c. A / W	0.55 / 138					
Rated making capacity acc. to IEC 60947-5-1	10 x I_e / AC-15					
Rated breaking capacity acc. to IEC 60947-5-1	10 x I_e / AC-15					
Short-circuit protection gG type fuse A	10					
Rated short-time withstand current I_{cw}						
for 1.0 s A	100					
for 0.1 s A	140					
Minimum switching capacity V / mA	17 / 5					
Non-overlapping time between N.O. and N.C. contacts ms	≥ 2					
Insulating resistance at 500 V d.c. after durability test MOhm	5					
Heat dissipation per pole at 6 A W	0.10					

IEC Technical data

AL9 — AL40

Mounting characteristics


Contactor types:	AL	AL9	AL12	AL16	AL26	AL30	AL40
Mounting positions	see "Conditions for use"						
Mounting distances	The contactors can be assembled side by side						
Mounting	on DIN rail						
	according to IEC 715 and EN 50022 / EN 50023						
	by screws (not supplied)						
	35 x 7.5 mm		35 x 15 mm		2 x M4		

Conditions for Use

Sustainable utilization conditions for contactors involving at the same time the Mounting position, Ambient temperature and Control voltage operating limits are summarized in the table below.

Contactors	Mounting position	Ambient temperature	Control voltage
AL9 – AL40	1, 1 ± 30°, 2, 3, 4, 5	≤ 55 °C	0.85 ... 1.1 x U _c
	6 (Unauthorized)	55 ... 70 °C	U _c

Mounting Positions (see the above table for authorized positions)

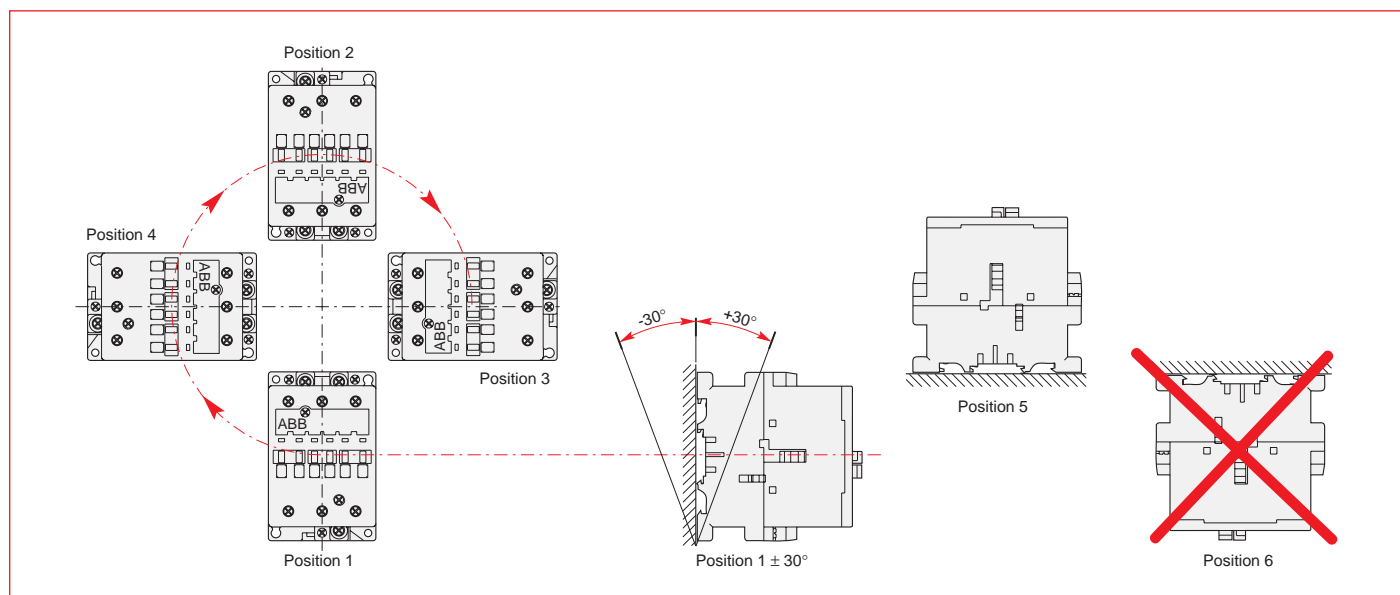

IEC Technical data

AL9 — AL40

Connecting Characteristics

Contactor types: **AL** AL9 AL12 AL16 AL26 AL30 AL40

Main terminals



Connecting capacity (min. ... max.)

Main conductors (poles)		AL9	AL12	AL16	AL26	AL30	AL40
Rigid: solid ($\leq 4 \text{ mm}^2$)	1 x mm^2	1 ... 4			1.5 ... 6	2.5 ... 16	
	stranded ($\geq 6 \text{ mm}^2$)	1 ... 4			1.5 ... 6	2.5 ... 16	
Rigid with connector	single for Cu cable						
	single for Al/Cu cable						
	double for Al/Cu cable						
Flexible with cable end	1 x mm^2	0.75 ... 2.5			0.75 ... 4	2.5 ... 10	
	2 x mm^2	0.75 ... 2.5			0.75 ... 4	2.5 ... 10	
Bars or lugs	L mm \leq 8	8			10		
	l mm $>$ 3.7	3.7			4.2		

Auxiliary conductors

(built-in auxiliary terminals + coil terminals)

Rigid solid	1 x mm^2	1 ... 4					
	2 x mm^2	1 ... 4					
Flexible with cable end	1 x mm^2	0.75 ... 2.5					
	2 x mm^2	0.75 ... 2.5					
Lugs	L mm \leq 8	8			①	8	
	l mm $>$ 3.7	3.7			①	3.7	

Degree of protection acc. to IEC 60947-1 / EN 60947-1 and IEC 60529 / EN 60529

Protection against direct contact acc. to VDE 0106 - Part. 100

- Main terminals
- Coil terminals
- Built-in auxiliary terminals

IP 20
IP 20
IP 20

Screw terminals

(delivered in open position, screws of unused terminals must be tightened)

Main terminals	(+,-) pozidriv 2 screws					
	M3.5		M4	M5		
Coil terminals	M3.5 (+,-) pozidriv 2 screws with cable clamp					
Built-in auxiliary terminals	(+,-) pozidriv 2 screws with cable clamp					
	M3.5		M4	M5		

Tightening torque

Main pole terminals						
	- recommended	Nm / lb.in	1.00 / 9		1.7 / 15	2.30 / 20
	- max.	Nm	1.20		2.20	2.60
Coil terminals						
	- recommended	Nm / lb.in	1.00 / 9			
	- max.	Nm	1.20			
Built-in auxiliary terminals						
	- recommended	Nm / lb.in	1.00 / 9		1.7 / 15	1.00 / 9
	- max.	Nm	1.20		2.20	1.20
Terminal marking and positioning			see pages 1.35			

① L \leq 8 and l $>$ 3.7 for coil terminal - L \leq 10 and l $>$ 4.2 for built-in auxiliary terminals.


② With LW 110 enlargement piece. See page 1.31.

IEC Technical data

EK110 — EK1000

General Technical Data

Contactor types:	EK...	110	150	175	210	370	550	1000
Rated insulation voltage U_i according to IEC 60947-4-1	V	1000						
according to UL/CSA	V	600						
Rated impulse withstand voltage U_{imp}	kV	8						
Standards		Devices complying with international standards IEC 60947-1 / 60947-4-1 and European standards EN 60947-1 / 60947-4-1						
Air temperature close to contactor		see "Conditions for use" page 1.63, for control voltage limits and authorized mounting positions						
– fitted with thermal O/L relay	°C	-25 to +55						
– without thermal O/L relay	°C	-40 to +70						
– for storage	°C	-50 to +70						
Climatic withstand		acc. to IEC 60068-2-30						
Operating altitude	m	≤ 3000						
Shock withstand acc. IEC 60068-2-27 and EN 60068-2-27								
Mounting position 1 (see page 1.63)		1/2 sinusoidal shock for 15 ms: no change in contact position Contactor in making or breaking position						
		Shock direction: A, C1, C2: 10 g B1: 10 g B2: 10 g						

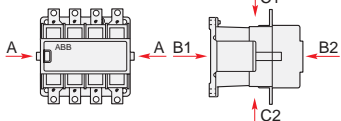



IEC Technical data

EK110 — EK1000

Across the line
contactors

1

Main Pole - Utilization Characteristics

Contactor types:	EK...	110	150	175	210	370	550	1000	
Rated operational voltage U_e max.	V	1000						690	
Rated frequency limits	Hz	25 ... 400							
Conventional free-air thermal current I_{th} acc. to IEC 60947-4-1, open contactors $\theta \leq 40^\circ\text{C}$	A	200	250	300	350	550	800	1000	
with conductor cross-sectional area	mm ²	95	150	185	240	2 x 185	2 x 240	2 x 300	
Rated operational current I_e / AC-1 for air temperature close to contactor									
U_e max. 690 V	$\theta \leq 40^\circ\text{C}$	A	200	250	300	350	550	800	1000
	$\theta \leq 55^\circ\text{C}$	A	180	230	270	310	470	650	800
	$\theta \leq 70^\circ\text{C}$	A	155	200	215	250	400	575	720
with conductor cross-sectional area	mm ²	95	150	185	240	2 x 185	2 x 240	2 x 300	
Utilization categorie AC-3									
for air temperature close to contactor $\leq 55^\circ\text{C}$									
Rated operational current I_e AC-3									
3-phase motors 	220-230-240 V	A	120	145	210	400	550	—	
	380-400 V	A	120	145	210	400	550	—	
	415 V	A	120	145	210	400	550	—	
	440 V	A	120	145	210	370	550	—	
	500 V	A	120	145	210	370	550	—	
	690 V	A	120	120	210	370	550	—	
	1000 V	A	64	80	113	155	175	—	
Rated operational power AC-3									
1500 r.p.m. 50 Hz	220-230-240 V	kW	30	45	59	110	160	—	
1800 r.p.m. 60 Hz	380-400 V	kW	55	75	110	200	280	—	
3-phase motors 	415 V	kW	55	75	110	220	315	—	
	440 V	kW	59	75	110	220	315	—	
	500 V	kW	75	90	132	250	400	—	
	690 V	kW	110	110	160	355	500	—	
	1000 V	kW	90	110	160	220	250	—	
Rated making capacity AC-3 according to IEC 60947-4-1									
			10 x I_e AC-3					—	
Rated breaking capacity AC-3 according to IEC 60947-4-1									
			8 x I_e AC-3					—	
Short-circuit protection for contactors without thermal O/L relay - Motor protection excluded									
$U_e \leq 500$ V a.c. - gG type fuse	A	250		355		630	800	1000	
Rated short-time withstand current I_{cw} at 40 °C ambient temp., in free air, from a cold state									
1 s	A	1700	1800	2300		5500		6800	
10 s	A	900	1200	1680		5300		6400	
30 s	A	600	700	1000		3700		4400	
1 min	A	450	550	800		3000		3400	
15 min	A	210	250	320		1000		1200	
Maximum breaking capacity $\cos \theta = 0.45$ ($\cos \theta = 0.35$ for $I_e > 100$ A)									
at 440 V	A	1400	1500	2000		5000	5400	—	
at 690 V	A	1100	1200	1700		5000	5400	—	
Heat dissipation per pole									
I_e / AC-1	W	10	13	18		40	60	80	
I_e / AC-3	W	3	5	9		15	25	—	
Max. electrical switching frequency									
- for AC-1	cycles/h	300						300	
- for AC-3	cycles/h	300						—	
- for AC-2, AC-4	cycles/h	150		120				—	
Electrical durability									
		see pages 1.75							
Mechanical durability									
- millions of operating cycles		10				5			
- max. mechanical switching frequency	cycles/h	3600				3600			

IEC Technical data

EK110 — EK1000

Magnet System Characteristics for EK... Contactors - a.c. Operated

Contactor types:	EK...	110	150	175	210	370	550	1000	
Rated control circuit voltage U_c									
- at 50 Hz	V	24 ... 500					48 ... 500		
- at 60 Hz	V	24 ... 600					110 ... 600		
Coil operating limits according to IEC 60947-4-1		$\vartheta \leq 70\text{ °C}$							
		0.85 ... 1.1 x U_c							
Drop-out voltage in % of U_c		roughly 45 ... 65 %							
Coil consumption									
Average pull-in value	50 Hz ^① VA	800		1100		3500			
	60 Hz ^① VA	900		1200		4000			
	50/60 Hz ^② VA/VA	500/500		630/630		3800/3400			
Average holding value	50 Hz ^① VA/W	44/15		52/18		125/50			
	60 Hz ^① VA/W	52/18		65/22		140/60			
	50/60 Hz ^② VA/W	2.5/2.5		2.5/2.5		140/60			
Operating time									
between coil energization and:									
- N.O. contact closing	ms	20 ... 40 ^① / 30 ... 50 ^②					30 ... 60		
- N.C. contact opening	ms	15 ... 35 ^① / 25 ... 45 ^②					25 ... 55		
between coil de-energization and:									
- N.O. contact opening	ms	7.5 ... 15 ^① / 95 ... 120 ^②					10 ... 20		
- N.C. contact closing	ms	10 ... 18 ^① / 100 ... 125 ^②					13 ... 23		

Magnet System Characteristics for EK... Contactors - d.c. Operated

Contactor types:	EK...	110	150	175	210	370	550	1000	
Rated control circuit voltage U_c	V d.c.	12 ... 220					24 ... 220		
Coil operating limits according to IEC 60947-4-1		$\vartheta \leq 70\text{ °C}$							
		0.85 ... 1.1 x U_c							
Drop-out voltage in % of U_c		roughly 15 ... 50 %							
Coil consumption - Average values									
- pull-in value	W	500		630		1100			
- holding value	W	2.5		2.5		20			
Coil time constant									
- open	L/R	ms 8					12		
- closed	L/R	ms 50					60		
Operating time									
between coil energization and:									
- N.O. contact closing	ms	30 ... 50					60 ... 80		
- N.C. contact opening	ms	27 ... 47					55 ... 75		
between coil de-energization and:									
- N.O. contact opening	ms	10 ... 35							
- N.C. contact closing	ms	13 ... 38							

① "A" coil voltage codes see page 1.29.

② 50/60 Hz "E" coil voltage codes see page 1.29.

IEC Technical data

EK110 — EK1000

Mounting Characteristics


Contactor types: EK...	110	150	175	210	370	550	1000
Mounting positions	see "Conditions for use"						
Fixing by screws (supplied)	4 x M6			4 x M6 (1)			

Conditions for Use

Sustainable utilization conditions for contactors involving at the same time the Mounting position, Ambient temperature and Control voltage operating limits are summarized in the table below.

Contactors	Mounting position	Ambient temperature	Control voltage
E110 ... EK210	1, 1 ± 30°, 3, 4, 5 2, 6 unauthorized	≤ 70 °C	0.85 ... 1.1 x U _c
E370 ... EK1000	1, 1 ± 30°, 2, 3, 4, 5 6 unauthorized	≤ 70 °C	0.85 ... 1.1 x U _c

Mounting Positions (see the above table for authorized positions)

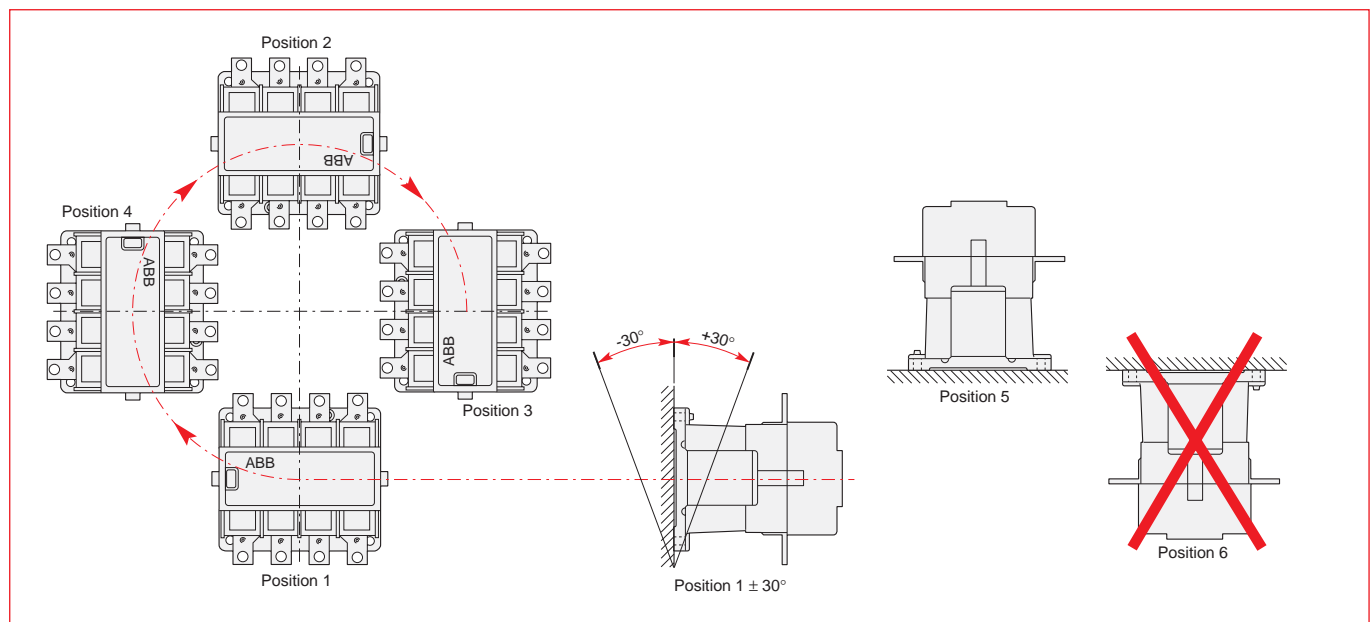


① Damping elements are supplied

IEC Technical data
EK110 — EK1000

Connecting Characteristics

Contactor types: EK...

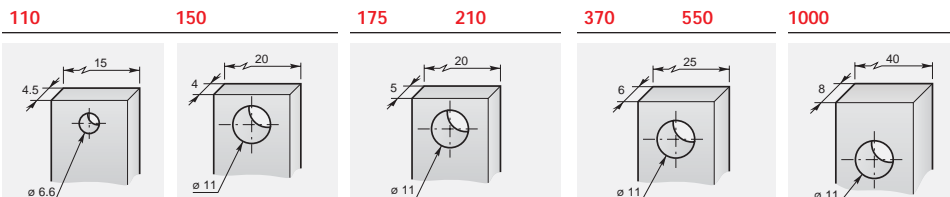Main terminals
Flat type

Connecting capacity (min. ... max.)

Main conductors (poles)

	110	150	175	210	370	550	1000
Rigid:							
1 x mm ²	-	-	-	-	-	-	-
2 x mm ²	-	-	-	-	-	-	-
Rigid with connector							
single for Cu cable mm ²	25 ... 120	25 ... 185		70 ... 300		-	
single for Al/Cu cable mm ²	10 ... 70	35 ... 120			70 ... 300		95 ... 300
double for Al/Cu cable mm ²	-	-			2 x 35 ... 185		2 x 95 ... 300
Flexible							
1 x mm ²	-	-	-	-	-	-	-
2 x mm ²	-	-	-	-	-	-	-
Bars or lugs							
L mm ≤	30	30	33		55		
Ø mm >	6	10	10		10		
Auxiliary conductors (coil terminals)							
Rigid solid							
1 x mm ²	0.5 ... 2.5						
2 x mm ²	0.5 ... 2.5						
Flexible with cable end							
1 x mm ²	0.5 ... 2.5						
2 x mm ²	0.5 ... 2.5						
Lugs							
L mm ≤	8						
l mm >	3.7						
Degree of protection acc. to IEC 60947-1 / EN 60947-1 and IEC 60529 / EN 60529	Protection against direct contact acc. to VDE 0106 - Part. 100						
- Main terminals	IP 00						
- Coil terminals	IP 20						
Screw terminals	Screws and bolts						
Main terminals	M6 M10						
Coil terminals (delivered in open position)	M3.5 (+,-) pozidriv 2 screws with cable clamp						
Tightening torque	Main pole terminals						
- recommended	Nm / lb.in	5 / 44	18 / 160				
- max.	Nm	6	22				
Coil terminals	- recommended						
- recommended	Nm / lb.in	1.00 / 9					
- max.	Nm	1.20					

IEC Technical data

Contactor electrical durability and Utilization categories

General

Utilization categories determine the current making and breaking conditions relating to the characteristics of the loads to be controlled by the contactors. International standard IEC 60947-4-1 and European standard EN 60947-4-1 are the standards to be referred to.

If I_c is the current to be broken by the contactor and I_e the rated operational current normally drawn by the load, then:

- Categories AC-1 and AC-3: $I_c = I_e$
- Category AC-2: $I_c = 2.5 \times I_e$
- Category AC-4: $I_c = 6 \times I_e$

Generally speaking $I_c = m \times I_e$ where m is a multiple of the load operational current.

On pages 1.66 - 1.71, the curves corresponding to categories AC-1, AC-2, AC-3 and AC-4 represent the electrical durability variation of standard contactors in relation to the breaking current I_c .

Electrical durability is expressed in millions of operating cycles.

These curves have been plotted for 400 V - 50 Hz 3-phase currents but remain valid up to 690 V - 40 ... 60 Hz provided that a check is carried out to make sure that at the operational voltage U_e , the current I_e normally drawn by the load does not exceed the value of the contactor rated operational current: $I_e / AC-1$ for category AC-1 and $I_e / AC-3$ for categories AC-3 and AC-4. The values are given for each type of contactor in pages 1.44, 1.45, 1.54, and 1.61 (Technical Data).

Curve Utilization Mode

Electrical durability forecast and contactor selection for categories AC-1, AC-2, AC-3 or AC-4

- Note the characteristics of the load to be controlled:
 - Operational voltage U_e
 - Current normally drawn I_e (U_e / I_e / kW relation for motors, + page 0/0).
 - Utilization category AC-1, AC-2, AC-3 or AC-4
 - Breaking current $I_c = I_e$ for AC-1 and for AC-3 ; $I_c = 2.5 \times I_e$ for AC-2 ; $I_c = 6 \times I_e$ for AC-4
- Define the number of operating cycles N required.
- On the diagram corresponding to the operational category, select the contactor with the curve immediately above the intersection point (I_c ; N).

Electrical durability forecast and contactor selection for mixed duty motor control: AC-3 ($I_c = I_e$) type switching off while "motor running" and, occasionally, AC-4 ($I_c = 6 \times I_e$) type switching off while "motor accelerating".

- Note the characteristics of the motor to be controlled:
 - Operational voltage U_e
 - Current normally drawn while "motor running" I_e (U_e / I_e / kW relation for motors, + 0/0).
 - Breaking current for AC-3 $I_c = I_e$
 - Breaking current for AC-4 while "motor accelerating" $I_c = 6 \times I_e$
 - Percentage of AC-4 operations K (on the basis of the total number of operating cycles)
- Define the total number of operating cycles N required.
- Note the smallest contactor rating compatible for AC-3 (U_e / I_e) on pages 2/62, 2/63, 2/73, and 2/79.
- For the selected contactor make a note of the following in relation to the voltage using diagram AC-3 page 2/85 and AC-4 page 2/86 or 2/87:
 - The number of operating cycles A for $I_c = I_e$ (AC-3)
 - The number of operating cycles B for $I_c = 6 \times I_e$ (AC-4)

- Calculate the estimated number of cycles N' (N' is always below A)

$$N' = \frac{A}{1 + 0.01 K (A/B - 1)}$$

- If N' is too low in relation to the target N , calculate the estimated number of cycles for a higher contactor rating.

Case of uninterrupted duty.

Among the different utilization categories, the uninterrupted duty implies the following remark. The combined effect of environmental conditions and the proper temperature of the product may require some disposals. As a matter of fact, for this duty, the use duration prevails over the number of operating cycles.

For long term service, some verifications of preventing maintenance are needed to check the functionality of the concerned product (consult us).

Over a duration of five years, in these conditions the contactor might present high internal resistance. We recommend to change the contactor or change the contacts.


IEC Technical data

A9 — AF750

Electrical durability

Electrical Durability for AC-1 Utilization Category. Ambient Temperature $\leq 55\text{ }^{\circ}\text{C}$

Switching non-inductive or slightly inductive loads. The breaking current I_c for AC-1 is equal to the rated operational current of the load.

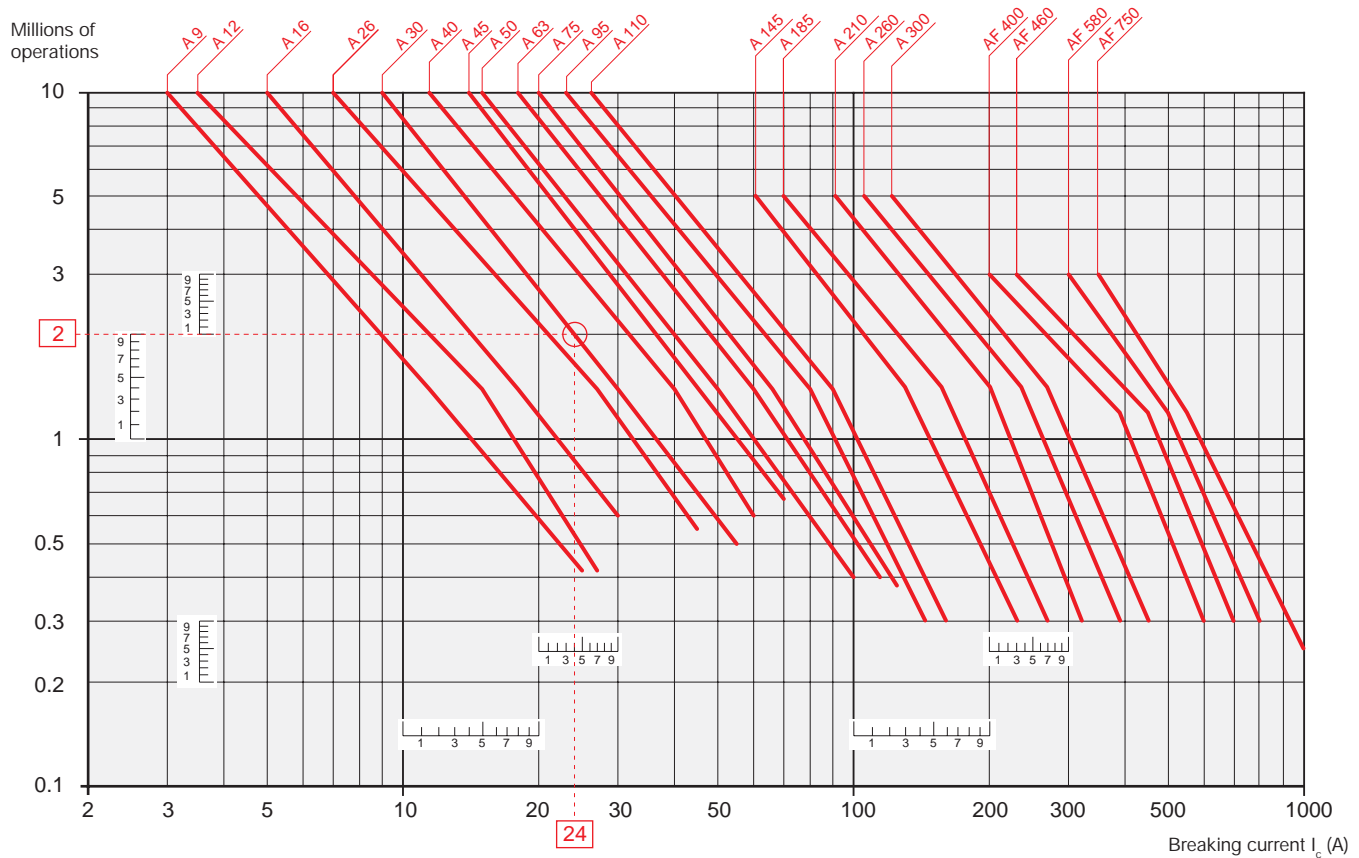

Example:

$I_c / \text{AC-1} = 24\text{ A}$ – Electrical durability required = 2 million operations.

Using the AC-1 curves above select the A 30 contactor at intersection "O" (24 A / 2 million operations).


IEC Technical data

A9 — AF750


Electrical durability

Switching cage motors: starting and switching off running motors. The breaking current I_c for AC-3 is equal to the rated operational current I_e (I_e = motor full load current).

Electrical Durability for AC-3 Utilization Category - $U_e \leq 440$ V. Ambient Temperature ≤ 55 °C

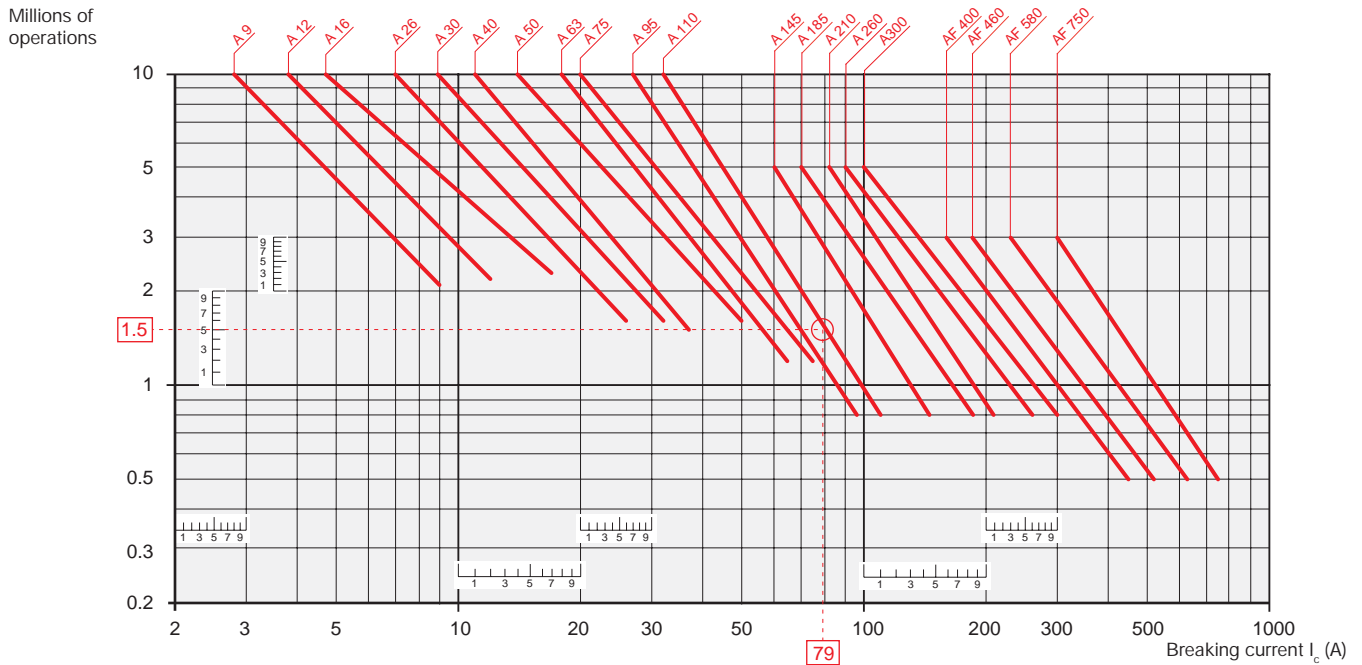

Electrical Durability for AC-3 Utilization Category - 440 V < $U_e \leq 690$ V. Ambient Temperature ≤ 55 °C

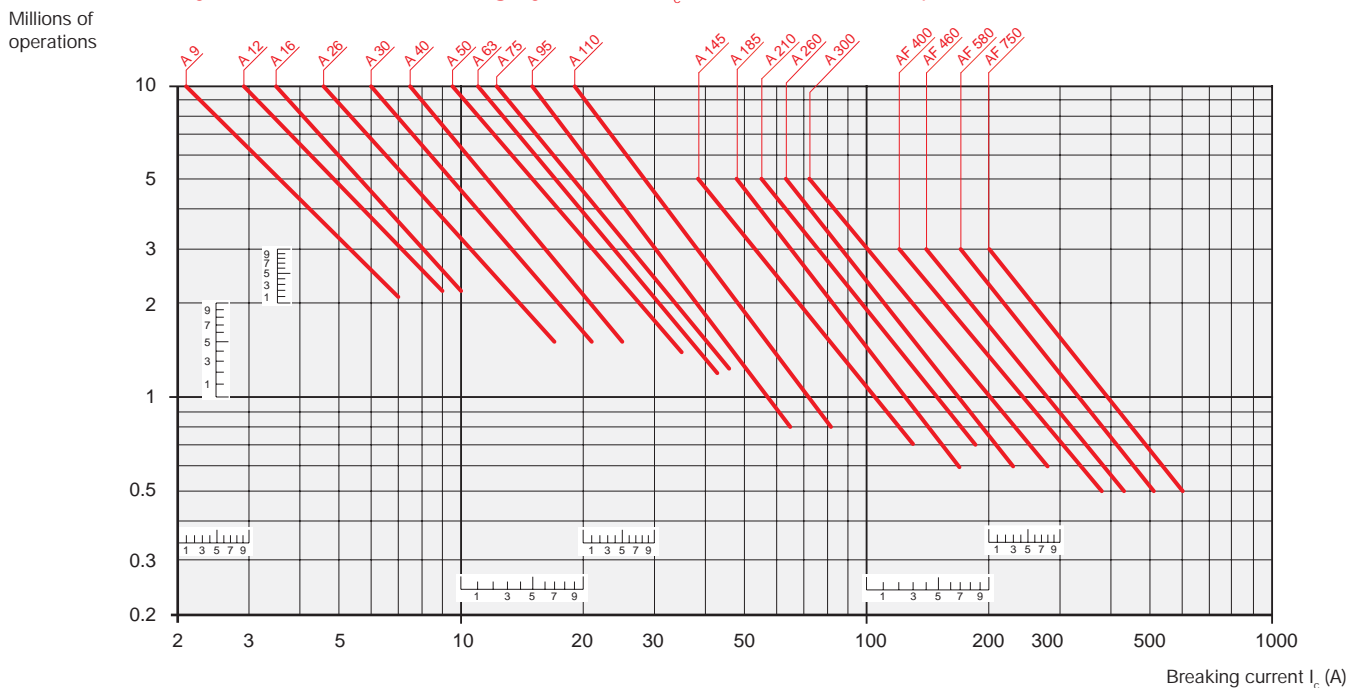

Example:

Motor power 40 kW for AC-3 - $U_e = 400$ V utilization – Electrical durability required = 1.5 million operations.

40 kW, 400 V corresponds to $I_e = 79$ A. For AC-3: $I_c = I_e$. Select the A 110 contactor at intersection "O" (79 A / 1.5 million operations) on the curves (AC-3 - $U_e \leq 440$ V).

IEC Technical data


A9 — AF750

Electrical durability

Electrical Durability for AC-2 or AC-4 Utilization Category - $U_e \leq 440$ V. Ambient Temperature ≤ 55 °C

Maximum number of AC-2 or AC-4 operations: 300 per hour for A 9 ... A 40 contactors,
150 per hour for A 50 ... A 300 contactors.

Switching cage motors: starting, reverse operation and step-by-step operation. The breaking current I_c is equal to $2.5 \times I_e$ for AC-2 and $6 \times I_e$ for AC-4, keeping in mind that I_e is the motor rated operational current (I_e = motor full-load current).

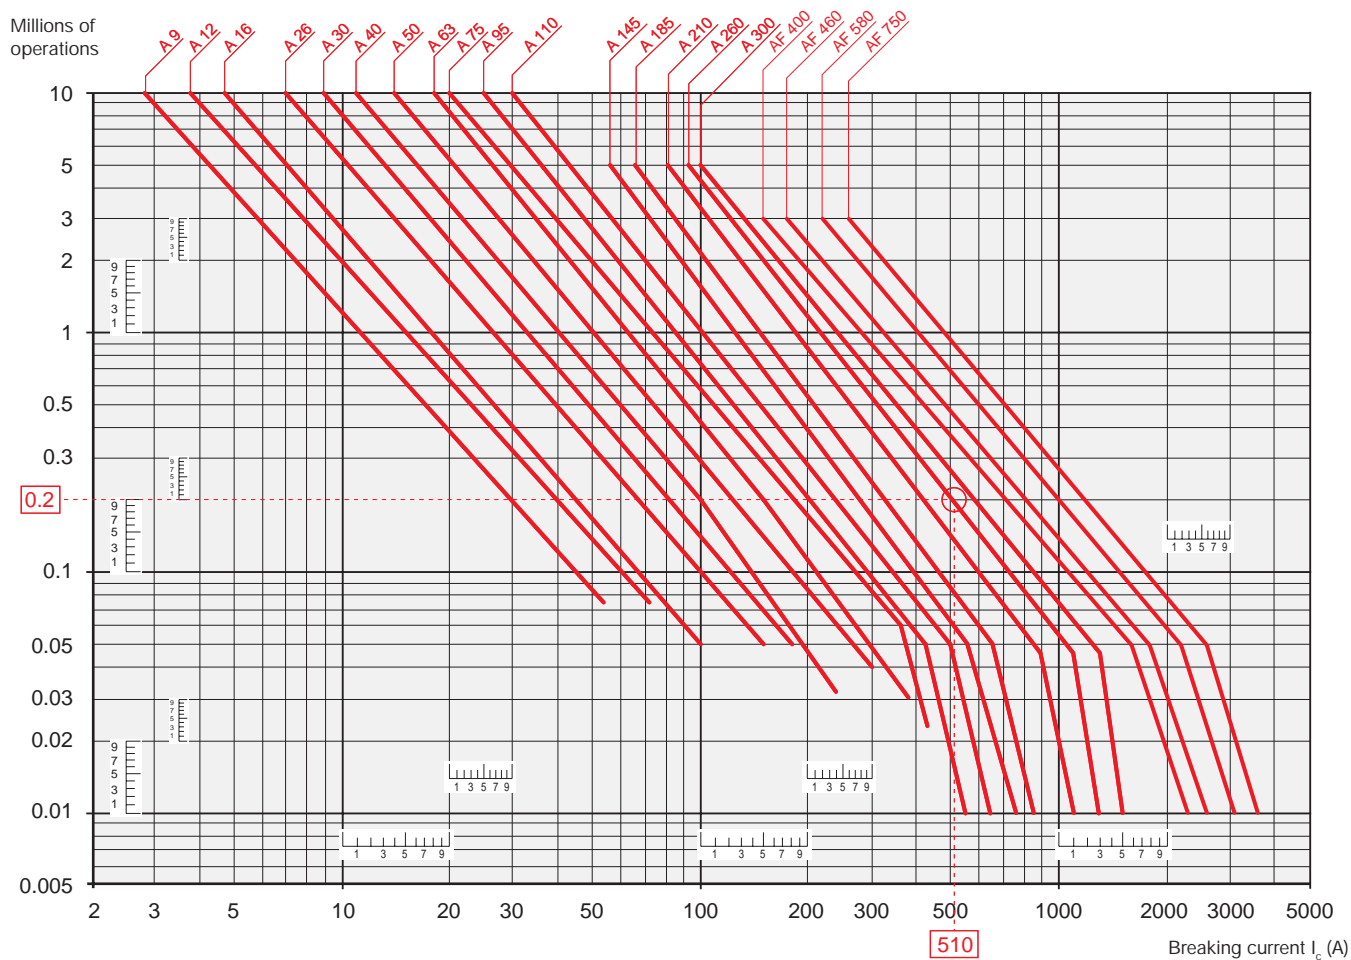

Example:

Motor power 45 kW for AC-4 - $U_e = 400$ V utilization – Electrical durability required = 0.2 million operations.

45 kW, 400 V corresponds to $I_e = 85$ A.

For AC-4: $I_c = 6 \times I_e = 510$ A - Select the A 260 contactor at intersection "O" (510 A / 0.2 million operations) on the curves (AC-4 - $U_e \leq 440$ V).

IEC Technical data


A9 — AF750

Electrical durability

Electrical Durability for AC-2 or AC-4 Utilization Category - $440\text{ V} < U_e \leq 690\text{ V}$. Ambient Temperature $\leq 55\text{ }^\circ\text{C}$

Maximum number of AC-2 or AC-4 operations: 300 per hour for A 9 ... A 40 contactors,
150 per hour for A 50 ... A 300 contactors.

Switching cage motors: starting, reverse operation and step-by-step operation. The breaking current I_c is equal to $2.5 \times I_e$ for AC-2 and $6 \times I_e$ for AC-4, keeping in mind that I_e is the motor rated operational current (I_e = motor full-load current).

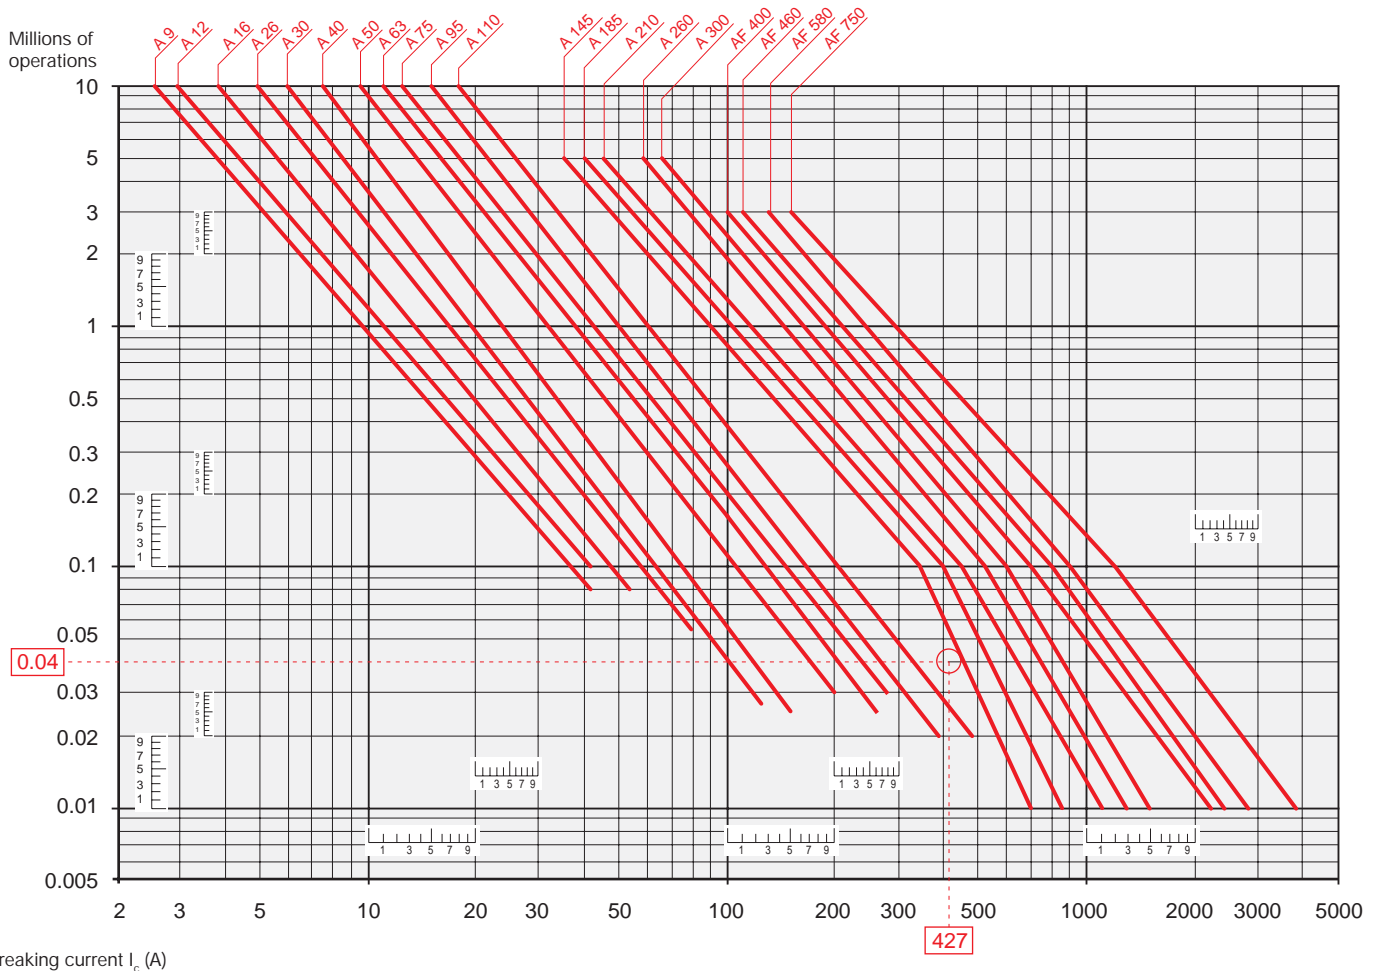

Example:

Motor power 59 kW for AC-4 - $U_e = 600\text{ V}$ utilization – Electrical durability required = 0.04 million operations.

As stated on page 0/0: 59 kW, 600 V corresponds to $I_e = 71.1\text{ A}$.

For AC-4: $I_c = 6 \times I_e = 426.6\text{ A}$ - Select the A 145 contactor at intersection "O" (427 A / 0.04 million operations) on the curves (AC-4 - $440\text{ V} < U_e \leq 690\text{ V}$).

IEC Technical data

AL9 — AL40

Electrical durability

Consult
factory


IEC Technical data

EK110 — EK1000

Electrical durability

Electrical Durability for AC-1 Utilization Category. Ambient Temperature $\leq 55\text{ }^{\circ}\text{C}$

Switching non-inductive or slightly inductive loads. The breaking current I_c for AC-1 is equal to the rated operational current of the load.

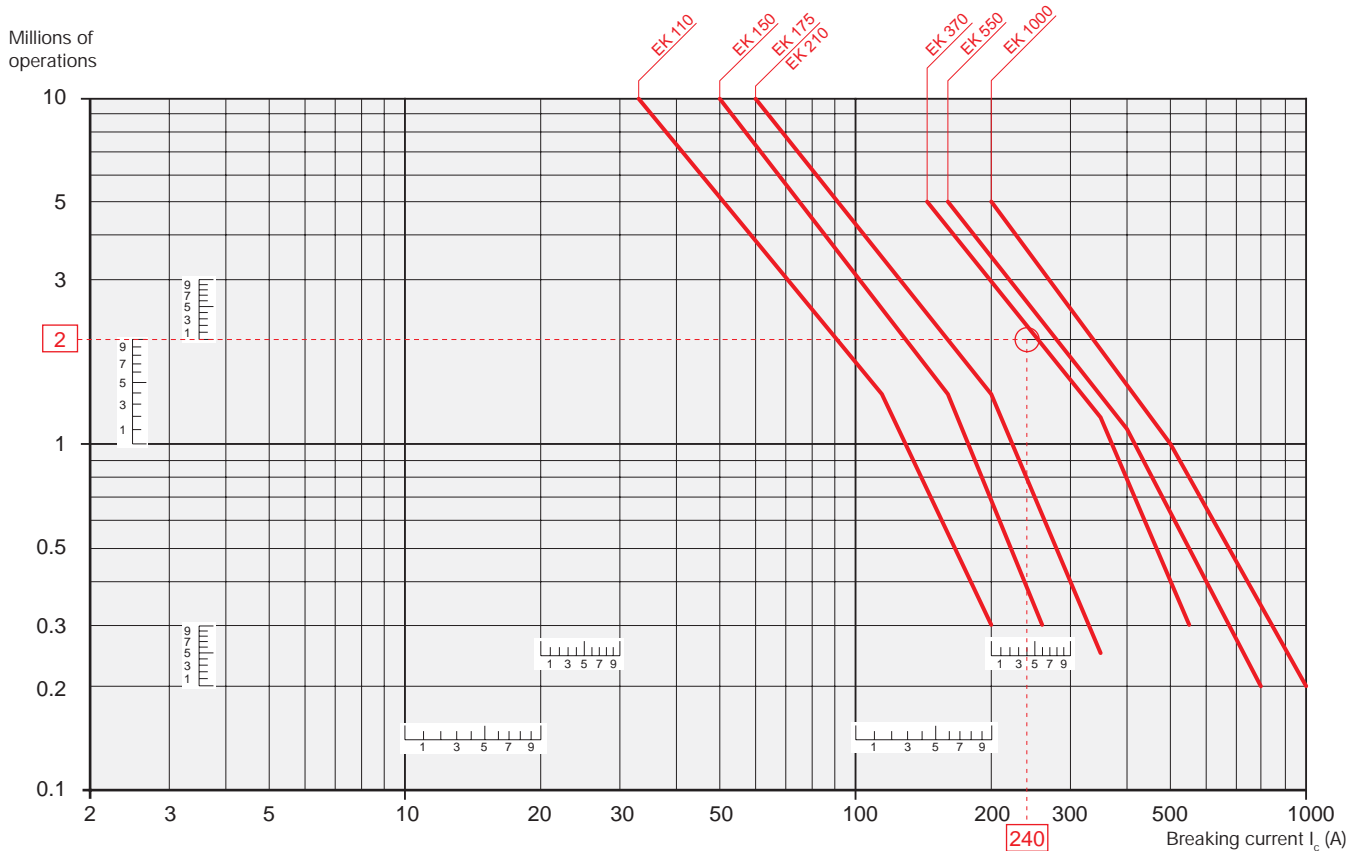

Example:

$I_c / \text{AC-1} = 240\text{ A}$ – Electrical durability required = 2 million operations.

Using the AC-1 curves above select the EK 370 contactor at intersection "O" (240 A / 2 million operations).

IEC Technical data

Influence of the length of conductors used in contactor control circuits



A 50-30-00



AF 460-30-11

Under certain conditions the excessive length of the control circuit conductors may prevent the contactor from carrying out closing and opening orders.

- no closing: due to excessive voltage drop (in a.c. or d.c.).
- no opening: due to excessive capacitance (in a.c.).

Contactor Closing (contactor with a.c. or d.c. fed control circuit)

The voltage drop is due to the pull-in current (pull-in power) and to the resistance of the control circuit conductors.

The table and graph below can be used to determine the single length of line feeders (distance between the control device and the contactor coil) in relation to:

- I the coil pull-in consumption.
- I the supply voltage.
- I the connecting wire cross-sectional area.


The graph has been drawn for a max. line voltage drop of 5 %.

Coil pull-in consumption (average value)

Contactors	a.c. control circuit 50 Hz	Contactors	d.c. control circuit
A 9, 12, 16	70 VA	AE 9, 12, 16	90 W
A 26, 30, 40	120 VA	AE 26, 30, 40	110 W
A 45, 50, 63, 75	180 VA	AE 45, 50, 63, 75	200 W
A 95, 110	450 VA	AE 95, 110	400 W
A 145, 185	700 VA	BC 9, 16, 18, 25, 30	7 W
A 210, 260, 300	1700 VA		
AF 45, 50, 63, 75	210 VA	AF 45, 50, 63, 75	190 W
AF 95, 110	350 VA	AF 95, 110	400 W
AF 145, 185	430 VA	AF 145, 185	500 W
AF 210, 260, 300	470 VA	AF 210, 260, 300	520 W
AF 400, 460	890 VA	AF 400, 460	990 W
AF 580, 750	850 VA	AF 580, 750	950 W

Permissible single length for the control circuit conductors on contactor closing:

Depending on the coil pull-in power consumption on the supply voltage and on the control circuit conductor cross-sectional area.

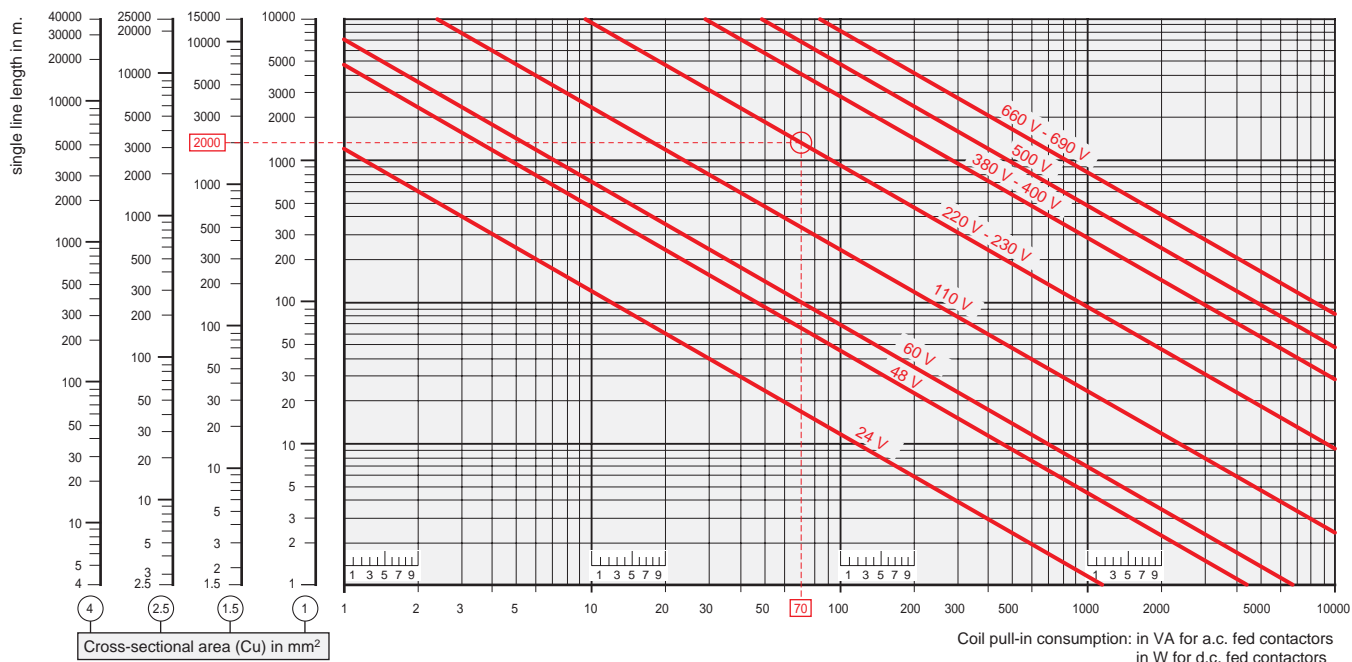

Example:

A 9 contactor

Coil voltage: 230 V 50 Hz, contactor coil pull-in power consumption: 70 VA,


control circuit conductor cross-sectional area: Cu 1.5 mm².

Max. permissible length: 2000 m.

IEC Technical data

Influence of the length of conductors used in contactor control circuits


Single control line length



Wiring diagram A

Via maintained pushbutton and 2-core cable (with a capacity of 0.2 μF/km, for example).

Single control line length



Wiring diagram B

Via momentary pushbutton plus hold-in contact and 3-core cable (with a capacity of 2 x 0.2 = 0.4 μF/km, for example).

Contactor Opening (contactor with a.c. fed control circuit)

Under certain conditions, an a.c. operated contactor does not open when the control circuit is de-energized.

This is due to a critical capacity of the excessively long control circuit line and the type of contactor coil control layout (see diagrams A and B opposite).

This may be caused by the following factors:

- high control voltage.
- low coil holding consumption.
- low contactor drop-out voltage (according to IEC 60947-4-1: 0.2 to 0.75 x U_c).

If lines longer than those indicated are required, the following measures must be taken:

- select a contactor with a higher rating.
- select a lower control voltage.
- connect "R_p" impedances in parallel with the contactor coil:

$$\text{sizing of parallel resistor: } R_p = \frac{10^3}{C} \quad (\text{with } C \text{ in } \mu\text{F})$$

The table and graph below can be used to determine the single length of line feeders (distance between the control device and the contactor coil) in relation to:

- the coil holding consumption VA.
- the supply voltage.
- the capacity in μF/km (depending on the control layout).


Wiring diagrams A and B opposite show two supply and coil control wiring examples.

Coil holding consumption (average value)

Contactors	a.c. control circuit 50 Hz	Contactors	a.c. control circuit 50 Hz
A 9, 12, 16	8 VA	AF 45, 50, 63, 75	7 VA
A 26, 30, 40	12 VA	AF 95, 110,	7 VA
A 45, 50, 63, 75	18 VA	AF 145, 185,	12 VA
A 95, 110	22 VA	AF 210, 260, 300	10 VA
A 145, 185	35 VA	AF 400, 460	12 VA
A 210, 260, 300	60 VA	AF 580, 750	12 VA

Permissible single length for the control circuit conductors on contactor opening:

Depending on the coil holding power consumption, on the supply voltage and on the control circuit conductor capacity.

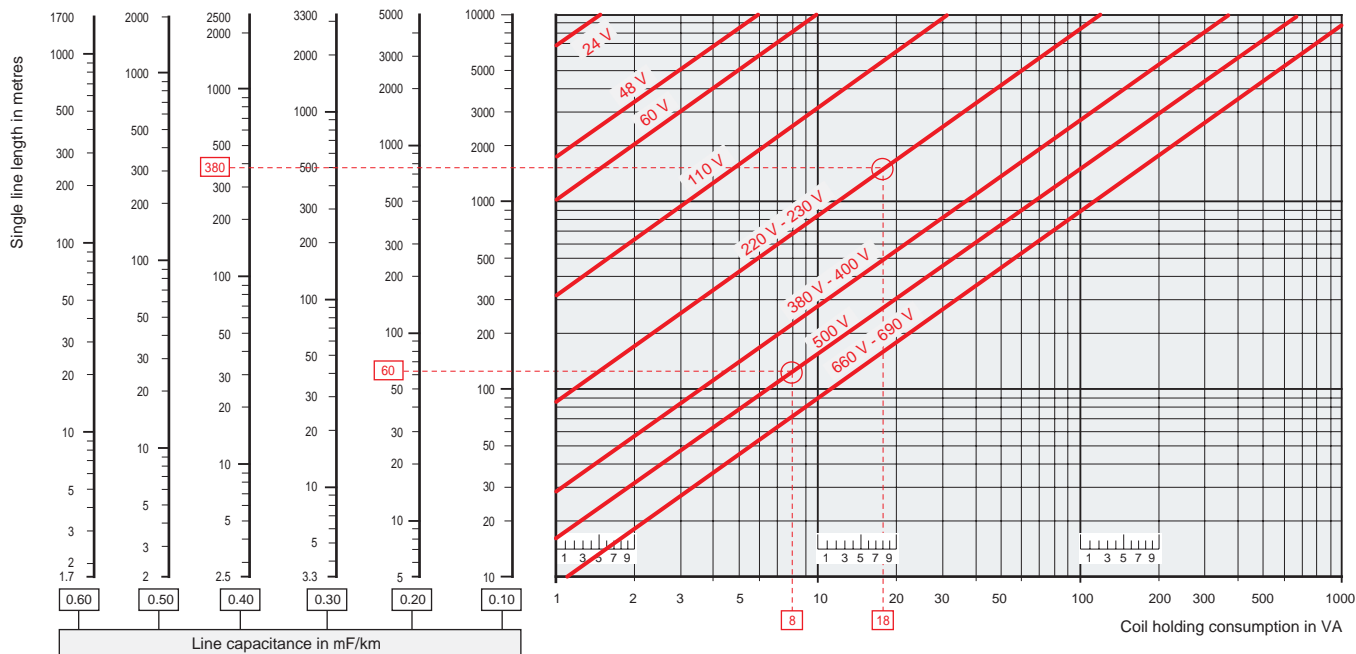

Examples:

A 16 contactor

Coil voltage U_c = 500 V, 50 Hz, 8 VA contactor coil holding consumption, control type: diagram A, via maintained pushbutton, and 2-core cable with a capacity of 0.2 μF/km.

Max. permissible length: 60 m.

A 50 contactor

Coil voltage U_c = 230 V, 50 Hz, 18 VA contactor coil holding consumption, control type: diagram B via momentary pushbutton, hold-in contact and 3-core cable with a capacity of 2 x 0.2 μF/km = 0.4 μF/km.

Max. permissible length: 380 m.

IEC Technical data

Parallel connection of main poles

Parallel Connection of Main Poles

Purpose: Increasing the a.c. resistive load.


Remarks:

- Parallel connection of main poles to increase the d.c. resistive load is not acceptable.
- Parallel connection of main poles does'nt increase the breaking capacity.

Means: The poles can be connected in parallel via shorting bars. See page 1.30.

- LP and LH for parallel connection of 2 poles,
- LY and LF for parallel connection of 3 poles,

The table below shows the uprating factor for $I_g / AC-1$ max. in relation to the number of poles in parallel and for a max. switching frequency.

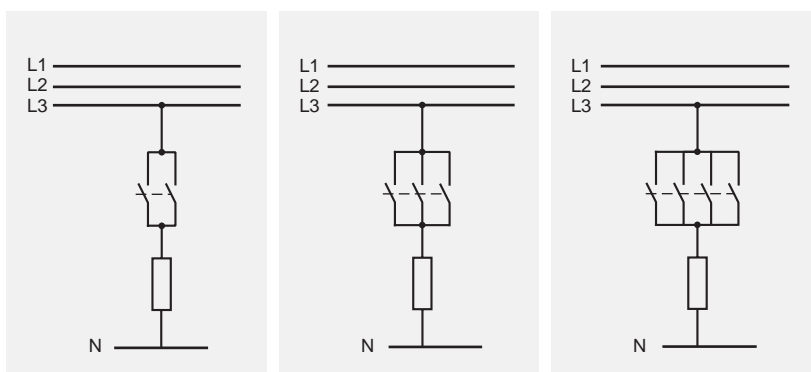

2 poles in //

3 poles in //

4 poles in //

Contactors			Factor to be applied to the rated operational current $I_g / AC-1$ to obtain the permissible current $I_g / AC-1$ with "n" poles in parallel.						
a.c. Operated	d.c. Operated	Cycles / h							
3-pole contactors									
A 9 ... A 75	AF 50 ... AF 75								
AF 50 ... AF 75	AE..., TAE...	600	1.6	2.2					
	AL...	A 95 ... A 300	AF 145 ... AF 750	300		1.6	2.2		–
AF 145 ... AF 750									
4-pole contactors									
A 9 ... A 75	AF 45 ... AF 75								
AF 45 ... AF 75	AE..., TAE...	600	1.6	2.2		2.6			
	AL...	EK...	EK...	300		1.6	2.2		2.8

IEC Technical data

Temporary or intermittent duty

Utilization of Contactors for Temporary / Intermittent Duty

The table below shows the factor to be applied to the rated operational current $I_e / AC-1$ to obtain the permissible operational current $I_e / AC-1$ in relation to the switching frequency and the current flow time per cycle.

Operating cycles per hour	120	60	20	6	2	1
Current flow time per cycle in seconds.	Factor to be applied to the rated operational current $I_e / AC-1$ max. to obtain the permissible current $I_e / AC-1$ for temporary / intermittent duty.					
5	2.8	3.4	4	4.7	5	5.2
10	2.2	2.6	3	3.4	3.7	3.8
20	1.6	2	2.4	2.6	2.7	2.8
30	-	1.7	2.1	2.2	2.3	2.4
40	-	1.5	1.9	2.0	2.1	2.2
60	-	-	1.7	1.8	1.8	1.9

Example:

A 9 contactor (intermittent duty, resistive load)

Rated operational current $I_e / AC-1$ at 55 °C (see page 1.42)

Switching frequency

Current flow time per cycle

Factor to be applied to the current $I_e / AC-1$

Permissible current: $2.7 \times 22 =$

22 A

2 operations/h

20 s

2.7

59 A

Technical data

Technical terms and definitions

Altitude

Refers to the height of the site where the equipment is located, expressed in meters above the sea level.

Ambient temperature

Temperature of the air surrounding the unit.

Circuits

• Auxiliary circuit

All the conducting parts of a contactor, intended to be included in a circuit different from the main circuit and the control circuit of the contactor e.g. signalization, interlocking circuits etc ...

• Control circuit

All the conducting parts of a contactor (other than the main circuit) included in a circuit used for the closing operation, or opening operation, or both, of the contactor.

• Main circuit

All the conducting parts of a contactor included in the circuit which it is designed to close or open.

Coil operating range

Expressed as a multiple of the rated control circuit voltage U_c for the lower and upper limits.

Cycle duration

Total time of the on-load + off-load period.

Endurance / durability

• Electrical endurance

Number of on-load operating cycles (i.e. with current on the main contacts) a contactor can achieve, varies depending on the utilization category.

• Mechanical endurance

Number of off-load operating cycles (i.e. without current on the main contacts) a contactor can achieve.

Inching

Energizing a motor once or repeatedly for short periods to obtain small movements of the driven mechanism.

Insulation class according to the VDE 0110 and NFC 20-040

Characterizes contactors suitability in accordance with environment and utilization conditions. A contactor can be classified depending on its own clearance and creepage distances in the insulation classes A, B, C, D which correspond to different insulation voltage values.

The insulation class C is applicable to most of the industrial applications. Equipment described in this catalogue correspond to insulation class C.

Intermittent duty

Duty in which the main contacts of a contactor remain closed for periods of time insufficient to allow the contactor to reach thermal equilibrium, the current-carrying periods being separated by off-load periods of sufficient duration to restore equality of temperature with the cooling medium.

Mounting positions

Stated by the manufacturer. Please note restrictions when applicable.

On-load factor

Ratio of the current flow time to the total time of the cycle x 100.

Plugging

Stopping or reversing a motor quickly by interchanging two supply leads whilst the motor is running.

Rated breaking capacity; Rated making capacity

Value of r.m.s current a contactor can break or make at a fixed voltage value, within the conditions specified by the standards, depending on the utilization category.

Rated control circuit voltage U_c

Control voltage value for which the control circuit of the unit is sized.

Rated insulation voltage U_i

Voltage value which designates the unit and to which dielectric tests, clearance and creepage distances are referred.

Rated impulse withstand voltage U_{imp}

The highest peak value of an impulse voltage of prescribed form 1.2/50, which does not cause breakdown under specified conditions of test.

Rated operating current I_e

Current value stated by the manufacturer and taking into account the rated operating voltage U_e , the rated frequency, the rated duty, the utilization category, the electrical contact life and the type of the protective enclosure.

Rated operating voltage U_e

Voltage value to which utilization characteristics of the contactor are referred, i.e. phase to phase voltage in 3 phase circuits.

Conventional thermal current I_{th}

Value of current the contactor can withstand with poles in closed position, in free air for an eight hour duty, without the temperature rise of its various parts exceeding the limits specified by the standards.

Resistance to shocks

Requirements applicable for instance to vehicles, crane operation or switchgear slide-in module systems.

At the quoted permissible «g» values, contactors must not undergo a change in switching state and O/L relays must not trip.

Resistance to vibrations

Requirements applicable to all the vehicles, vessels and other similar transport systems. At the quoted amplitude and vibration frequency values, the unit must be capable to achieve the required duty.

Short-circuit protection co-ordination

Achieved by using back-up protection devices such as circuit-breakers, H.R.C. fuses or standard fuses.

Co-ordination types a, b, c are defined in IEC 292-1 publication, VDE 0660, NFC 63-650 standards. Co-ordination types "1" and "2" are defined in IEC 947-4-1.

• Type 1 co-ordination

There has been no discharge of parts beyond the enclosure. Damage to the contactor and the overload relay is acceptable.

• Type 2 co-ordination

No damage to the overload relay or other parts has occurred, except that welding of contactor or starter contacts is permitted, if they are easily separated.

Switching frequency

Number of operating cycles per hour.

Time

• Closing time

Time between energization of the coil until the moment the contacts of the first current path to be closed actually close.

• Opening time

Time from the beginning of state causing breaking until the moment when the contacts of the last current path to be opened are open.

• Minimal operation time

Shortest control duration to ensure complete closing or opening of a contactor.

• Short time current permissible

Value of current which the contactor can withstand in closed position for a short time period and within specified conditions.

• Time constant

Ratio of inductance to the resistance : $L/R = \text{mH}/\text{Ohm} = \text{ms}$.

Standards

- IEC standards 158-1: "Contactors" and series IEC 292 :

"Motor-starters" have been revised and replaced by the new IEC 947-4-1 (1990-05): "Contactors and Motor-starters" referring to IEC 947-1 (1988): "General rules"
The new standards will constitute the basis of the future European and National standards, not yet revised.

Therefore the ratings indicated in this catalog are established according to the former and the future standards.

- Main changes and additions in the new standards are:
- Revision and extension of the utilization categories (see hereafter)
- Replacement of the coordination classes types a, b, c by new types: "1" (approximately equivalent to former class "a") and "2" (approximately equivalent to former class "c") with additional requirements.
- Classification of the thermal overload relays in tripping classes: 10 A; 10; 20 and 30 depending on their tripping times, at 1.5 and 7.2 times their setting current, in order to cover motor applications depending on their starting times. Class 10 A is adapted for motors according to IEC 34-1.
- Introduction of tests to verify the connecting capability and the mechanical strength of terminals.

Utilization categories

A contactor duty is characterized by the utilization category plus indication of the rated operating voltage and the rated operating current (see at Rated ...), or the motor characteristics.

Utilization categories for contactors according to IEC 947-4-1

Alternating current:	AC-1	Non-inductive or slightly inductive loads, resistance furnaces. Power factor 0.7 - 0.8 (slightly inductive).
	AC-2	Slip-ring motors: starting, switching-off.
	AC-3	Squirrel-cage motors: starting, switching-off motors during running. Power factor 0.4 - 0.5 (AC-3).
	AC-4	Squirrel-cage motors: starting, plugging, inching.
	AC-5a	Switching of electric discharge lamp controls.
	AC-5b	Switching of incandescent lamps.
	AC-6a	Switching of transformers.
	AC-6b	Switching of capacitor banks
	AC-8a AC-8b	Hermetic refrigerant compressor motor control with manual resetting of overload releases Hermetic refrigerant compressor motor control with automatic resetting of overload releases.
Direct current:	DC-1	Non-inductive or slightly inductive loads, resistance furnaces.
	DC-3	Shunt motors: starting, plugging, inching. Dynamic breaking of d.c. motors.
	DC-5	Series motors: starting, plugging, inching. Dynamic breaking of d.c. motors.
	DC-6	Switching of incandescent lamps

Utilization categories for contactor relays according to IEC 947-5-1

Alternating current:	AC-12	Control of resistive loads and solid state loads with isolation by opto couplers.
	AC-13	Control of solid state loads with transformer isolation.
	AC-14	Control of small electromagnetic loads (≤ 72 VA).
	AC-15	Control of electromagnetic loads (> 72 VA).
Direct current:	DC-12	Control of resistive loads and solid state loads with isolation by opto couplers.
	DC-13	Control of electromagnets.
	DC-14	Control of electromagnetic loads having economy resistors in circuit.

Utilization categories AC-1, AC-2, AC-3, AC-4 and DC-1, DC-3, DC-5 are maintained with slightly more severe tests.

Other categories have been added in order to standardize specific applications. In fact some contactor applications and the specific criteria characterizing the types of load controlled can modify the recommended utilization characteristics. These major applications are, for example :

Switching of capacitor banks

This application is characterized by high current peaks when switching-on the contactor and presence of harmonic currents on uninterrupted duty. For this application, IEC 947-4-1 has defined an utilization category AC-6b. Practical ratings have to be defined according to tests or, in absence of tests, by a calculation indicated in IEC 947-4-1.

Switching of transformers

This application is characterized by high current peaks on contactor closing due to magnetization phenomena. The corresponding utilization category according to IEC 947-4-1 is AC-6a. Ratings are derived from test-values for AC-3 or AC-4 according to formula given in IEC 947-4-1.

Switching of lighting circuits

The current peaks on contactor closing and power factor vary depending on the type of lamps, the switching method used and if compensation systems are fitted or not.

IEC 947-4-1 contains two standard utilization categories

- AC-5a for switching of the electric discharge lamps.
- AC-5b for switching of incandescent lamp.

UL/CSA Technical data

Motor data

Ampere ratings of 3 phase, AC induction motors

Horse power	110 – 120V			200 – 208V			220 – 240V			380 – 415V ^①		440 – 480V			550 – 600V		
	Single phase	Two phase	Three phase	Single phase	Two phase	Three phase	Single phase	Two phase	Three phase	Single phase	Three phase	Single phase	Two phase	Three phase	Single phase	Two phase	Three phase
1/10	3.0	—	—	1.65	—	—	1.5	—	—	1.0	—	—	—	—	—	—	—
1/8	3.8	—	—	2.1	—	—	1.9	—	—	1.2	—	—	—	—	—	—	—
1/6	4.4	—	—	2.4	—	—	2.2	—	—	1.4	—	—	—	—	—	—	—
1/4	5.8	—	—	3.2	—	—	2.9	—	—	1.8	—	—	—	—	—	—	—
1/3	7.2	—	—	4.0	—	—	3.6	—	—	2.3	—	—	—	—	—	—	—
1/2	9.8	4.0	4.4	5.4	2.2	2.4	4.9	2.0	2.2	3.2	1.3	2.5	1.0	1.1	2.0	0.8	0.9
3/4	13.8	4.8	6.4	7.6	2.6	3.5	6.9	2.4	3.2	4.5	1.8	3.5	1.2	1.6	2.8	1.0	1.3
1	16.0	6.4	8.4	8.8	3.6	4.6	8.0	3.2	4.2	5.1	2.3	4.0	1.6	2.1	3.2	1.3	1.7
1 1/2	20.0	9.0	12.0	11.0	5.0	6.6	10.0	4.5	6.0	6.4	3.3	5.0	2.3	3.0	4.0	1.8	2.4
2	24.0	11.8	13.6	13.2	6.5	7.5	12.0	5.9	6.8	7.7	4.3	6.0	3.0	3.4	4.8	2.4	2.7
3	34.0	16.6	19.2	18.7	9.2	10.6	17.0	8.3	9.6	10.9	6.1	8.5	4.2	4.8	6.8	3.3	3.9
5	56.0	26.4	30.4	30.8	14.5	16.8	28.0	13.2	15.2	17.9	9.7	14.0	6.6	7.6	11.2	5.3	6.1
7 1/2	80.0	38.0	44.0	44.0	21.0	24.2	40.0	19.0	22.0	27.0	14.0	21.0	9.0	11.0	16.0	8.0	9.0
10	100.0	48.0	56.0	55.0	26.4	30.8	50.0	24.0	28.0	33.0	18.0	26.0	12.0	14.0	20.0	10.0	11.0
15	135.0	72.0	84.0	75.0	39.6	46.2	68.0	36.0	42.0	44.0	27.0	34.0	18.0	21.0	27.0	14.0	17.0
20	—	94.0	108.0	96.8	52.0	60.0	88.0	47.0	54.0	56.0	34.0	44.0	23.0	27.0	35.0	19.0	22.0
25	—	118.0	136.0	121.0	65.0	75.0	110.0	59.0	68.0	70.0	44.0	55.0	29.0	34.0	44.0	24.0	27.0
30	—	138.0	160.0	150.0	76.0	88.0	136.0	69.0	80.0	87.0	51.0	68.0	35.0	40.0	54.0	28.0	32.0
40	—	180.0	208.0	194.0	100.0	115.0	176.0	90.0	104.0	112.0	66.0	88.0	45.0	52.0	70.0	36.0	41.0
50	—	226.0	260.0	238.0	125.0	143.0	216.0	113.0	130.0	139.0	83.0	108.0	56.0	65.0	86.0	45.0	52.0
60	—	—	—	—	147.0	160.0	—	133.0	154.0	—	103.0	—	67.0	77.0	—	53.0	62.0
75	—	—	—	—	183.0	212.0	—	166.0	192.0	—	128.0	—	83.0	96.0	—	66.0	77.0
100	—	—	—	—	240.0	273.0	—	218.0	248.0	—	165.0	—	109.0	124.0	—	87.0	99.0
125	—	—	—	—	—	344.0	—	—	312.0	—	208.0	—	135.0	156.0	—	108.0	125.0
150	—	—	—	—	—	396.0	—	—	360.0	—	240.0	—	156.0	180.0	—	125.0	144.0
200	—	—	—	—	—	528.0	—	—	480.0	—	320.0	—	208.0	240.0	—	167.0	192.0
250	—	—	—	—	—	663.0	—	—	602.0	—	403.0	—	—	302.0	—	—	242.0
300	—	—	—	—	—	—	—	—	—	—	482.0	—	—	361.0	—	—	289.0
350	—	—	—	—	—	—	—	—	—	—	560.0	—	—	414.0	—	—	336.0
400	—	—	—	—	—	—	—	—	—	—	636.0	—	—	477.0	—	—	382.0
500	—	—	—	—	—	—	—	—	—	—	786.0	—	—	590.0	—	—	472.0

① To obtain full load currents for 265V and 277V motors, decrease corresponding 220 – 240V ratings by 13 percent and 17 percent.